

**NIST Technical Note XXXX**

**Smoke Alarm Performance in Kitchen Fires and Nuisance  
Alarm Scenarios**

Thomas G. Cleary  
Artur Chernovsky

<http://dx.doi.org/10.6028/NISTTN.XXXX>

*Rebecca M. Blank, Acting Secretary*

National Institute of Standards and Technology  
*Patrick D. Gallagher, Under Secretary of Commerce for Standards and Technology and Director*

Certain commercial entities, equipment, or materials may be identified in this document in order to describe an experimental procedure or concept adequately. Such identification is not intended to imply recommendation or endorsement by the National Institute of Standards and Technology, nor is it intended to imply that the entities, materials, or equipment are necessarily the best available for the purpose.

**National Institute of Standards and Technology Technical Note XXXX**  
**Natl. Inst. Stand. Technol. Tech. Note XXXX, NNN pages (Month and Year)**  
**<http://dx.doi.org/10.6028/NISTTN.XXXX>**  
**CODEN: NTNOEF**

# NIST Technical Note XXXX

## Smoke Alarm Performance in Kitchen Fires and Nuisance Alarm Scenarios

Thomas G. Cleary  
Artur Chernovsky  
*Engineering Laboratory*

<http://dx.doi.org/10.6028/NISTTN.XXXX>

November, 2012



U.S. Department of Commerce

DRAFT



## Abstract

Experiments were conducted to assess the performance of various residential smoke alarms in kitchen fires and nuisance alarm cooking scenarios. A structure representing a kitchen, living room, and hallway was constructed to conduct the experiments. Eight different residential smoke alarm types, two photoelectric models (P1 and P2), two ionization models (I1 and I2), two dual-sensor photoelectric/ionization (D1 and D2) models, and two multisensor, intelligent models (M1 and M2) were used in this study. The data gathered provide insight into the susceptibility of alarm activation from exposures to typical cooking events and alarm times for actual kitchen fires. The effects on the alarm and its distance from the cooking activity or fire were examined. Combustible materials typically found on a counter top can spread flames to overhead cabinets, and a single empty 0.6 m wide, 1.0 m tall cabinet can produce a peak heat release rate nearly sufficient to flashover a small room. A protective metal barrier on the bottom and side facing the range tended to limit the spread of flames to the cabinet and reduce the heat release rate. All tested smoke alarms responded before hazardous conditions developed. An ionization alarm (I1) tended to respond first at a given location. Results show test smoke alarms placed at the furthest location from the fire source may provide less than 120 seconds of available safe egress time, which suggests a more central alarm location, closer to the kitchen, may provide earlier detection for specific scenarios. Ten cooking activities were examined to determine an alarm's propensity to activate to cooking aerosols. In most cases, the propensity to nuisance alarm decreased as the distance from the cooking source increased. Two alarms (I1 and D2) experienced more nuisance alarm activations across all cooking activities and locations than all other alarms tested. All alarms except I1 and D2 experienced about the same nuisance alarm frequency across all cooking activities for locations outside the kitchen.

## **Disclaimer**

### **U. S. Consumer Product Safety Commission**

*The views expressed in this report are those of the CPSC staff and/or its contractor and have not been reviewed or approved by, and may not necessarily reflect the views of, the Commission.*

## **Acknowledgements**

The authors acknowledge Michael Selepak, Anthony Chakalis, Doris Rinehart, Jay McElroy, and Laurean Delauter for their assistance with the set up and gathering data. We also want to thank the Montgomery County Fire and Rescue Service for the use of the burn prop building at the Public Safety Training Academy, and Assistant Chief Mike Clemens and Captain Audrey Deputy for their assistance.

This project was funded by an interagency agreement with the U. S. Consumer Product Safety Commission. The technical monitor of the contract was Mr. Arthur Lee.

# Table of Content

Abstract .....	iii
Disclaimer .....	iv
Acknowledgements .....	iv
1 Introduction .....	1
2 Experimental Plan.....	3
2.1 Smoke Alarm Sensitivity Test Protocol.....	4
2.2 Fire Scenario Designs and Heat Release Rate Measurement .....	8
2.3 Full-Scale Tests.....	12
2.3.1 Test Structure .....	12
2.3.2 Measurement Equipment .....	14
2.3.4 Kitchen Fire Experimental Protocols.....	20
3 Results and Analysis.....	21
3.1 Smoke Alarm Sensitivity Measurements.....	21
3.2 Fire Scenario Heat Release Rates .....	22
3.3 Nuisance Alarm Performance .....	32
3.4 Kitchen Fire Alarm Performance.....	56
4 Conclusions .....	79
5 References .....	81

## List of Figures

Figure 1. Schematic of the NIST fire emulator/detector evaluator (units in cm). .....	4
Figure 2. Smoke sensitivity test limits for UL217. Data points are measured values from the FE/DE smoldering cotton smoke. ....	5
Figure 3. CO concentration versus MIC current for steady cotton wick burning periods. Open and closed symbols represent different sets of wicks. ....	6
Figure 4. MIC current and laser transmittance for an ignition sequence of six sets of wicks .....	7
Figure 5. An expanded view of the MIC current and laser beam transmittance for the 4 <sup>th</sup> and 5 <sup>th</sup> set of wicks. The interval averages 1 and 2 represent the steady wick smoke concentration levels. ....	8
Figure 6. Configuration for ignition scenario 1. ....	9
Figure 7. Configuration for ignition scenario 2. ....	10
Figure 8. Sheet metal barrier on bottom and side of wall cabinet.....	10
Figure 9. Kitchen counter and cabinet mock-up. The counter level rests on load cells, and the entire mock-up fits under the furniture calorimeter hood. ....	11
Figure 10. Exterior view of the burn prop building. ....	12
Figure 11. Schematic of the living space mock-up. ....	13
Figure 12. Picture of the kitchen counter and cabinet mock-up. ....	13
Figure 13. Picture showing alarm placements, extinction meter, sampling tubes, and window and door openings. ....	14
Figure 14. Toasting bread configuration and toasted bread exemplars. ....	15
Figure 15. Toasted bagel exemplar. ....	16
Figure 16. Frying bacon configuration and fried bacon exemplar.....	16
Figure 17. Frying hamburger configuration and fried hamburger exemplar. ....	17
Figure 18. Broiling hamburger configuration and broiled hamburger exemplar.....	18
Figure 19. Grilled cheese sandwich configuration and prepared sandwich exemplar. ....	18
Figure 20. Stir-fry vegetables before and after cooking. ....	19
Figure 21. Baking pizza configuration and cooked pizza. ....	20
Figure 22. Configuration of kitchen counter and cabinet with ignition scenario 1 shown. ....	20
Figure 23. Heat release rate for Test A1 - Oak/pressboard exposed to ignition scenario 1.....	24
Figure 24. Photo sequence for Test A1 - Oak/pressboard exposed to ignition scenario 1. ....	24
Figure 25. Heat release rate for Test B1 – Laminated pressboard exposed to ignition scenario 1. ....	25
Figure 26. Photo sequence for Test B1 - Laminated pressboard exposed to ignition scenario 1. ....	25
Figure 27. Heat release rate for Test A1B - Oak/pressboard with barrier exposed to ignition scenario 1. ....	26
Figure 28. Photo sequence for Test A1B - Oak/pressboard with barrier exposed to ignition scenario ....	26
Figure 29. Heat release rate for Test B1B – Laminated pressboard with barrier exposed to ignition scenario 1. ....	27
Figure 30. Photo sequence for Test B1B – Laminated pressboard with barrier exposed to ignition scenario 1. ....	27
Figure 31. Heat release rate for Test A2 - Oak/pressboard exposed to ignition scenario 2.....	28
Figure 32. Photo sequence for Test A2 - Oak/pressboard exposed to ignition scenario 2. ....	28
Figure 33. B2 Heat release rate for Test B2 – Laminated pressboard exposed to ignition scenario 2. ....	29
Figure 34. Photo sequence for Test B2 - Laminated pressboard exposed to ignition scenario 2. ....	29
Figure 35. Heat release rate for Test CB1 – Cement board exposed to ignition scenario 1. ....	30

Figure 36. Photo sequence for Test CB1 – Cement board exposed to ignition scenario 1.....	30
Figure 37. Heat release rate for Test CB2 – Cement board exposed to ignition scenario 2. ....	31
Figure 38. Photo sequence for Test CB2 – Cement board exposed to ignition scenario 2.....	31
Figure 39. Location of alarms. ....	32
Figure 40. Fraction of smoke alarms that activated during range top cooking events.....	53
Figure 41. Fraction of smoke alarms that activated during oven cooking events.....	54
Figure 42. Fraction of smoke alarms that activated during toasting events.....	55
Figure 43. Alarm activation frequency for equal fractions of range top, oven, and toasting activities....	55
Figure 44. Photo sequence for experiment A1_1 (Oak/pressboard, scenario 1).....	57
Figure 45. Post-fire photo of experiment A1_1 (Oak/pressboard, scenario 1). ....	58
Figure 46. OD and FED values for experiment A1_1 (Oak/pressboard, scenario 1). ....	58
Figure 47. Photo sequence for experiment A1_2 (Oak/pressboard, scenario 1).....	59
Figure 48. OD and FED values for experiment A1_2 (Oak/pressboard, scenario 1). ....	60
Figure 49. Photo sequence for experiment A2_1 (Oak/pressboard, scenario 2).....	61
Figure 50. Post-fire photo of experiment A2_1 (Oak/pressboard, scenario 2). ....	61
Figure 51. OD and FED values for experiment A2_1 (Oak/pressboard, scenario 2). ....	62
Figure 52. Photo sequence for experiment A2_2 (Oak/pressboard, scenario 2).....	63
Figure 53. Post-fire photo of experiment A2_2 (Oak/pressboard, scenario 2). ....	63
Figure 54. OD and FED values for experiment A2_2 (Oak/pressboard, scenario 2). ....	64
Figure 55. Photo sequence for experiment B1_1 (Laminated pressboard, scenario 1).....	65
Figure 56. Post-fire photo of experiment B1_1 (Laminated pressboard, scenario 1). ....	65
Figure 57. OD and FED values for experiment B1_1 (Laminated pressboard, scenario 1). ....	66
Figure 58. Photo sequence for experiment B1_2 (Laminated pressboard, scenario 1).....	67
Figure 59. Post-fire photo of experiment B1_2 (Laminated pressboard, scenario 1). ....	67
Figure 60. OD and FED values for experiment B1_2 (Laminated pressboard, scenario 1). ....	68
Figure 61. Photo sequence for experiment B2_1 (Laminated pressboard, scenario 2).....	69
Figure 62. OD and FED values for experiment B2_1 (Laminated pressboard, scenario 2). ....	69
Figure 63. Photo sequence for experiment B2_2 (Laminated pressboard, scenario 2).....	70
Figure 64. Post-fire photo of experiment B2_2 (Laminated pressboard, scenario 2). ....	71
Figure 65. OD and FED values for experiment B2_2 (Laminated pressboard, scenario 2). ....	71
Figure 66. Photo sequence for experiment A3_1 (Oak/pressboard with sheet metal barrier, scenario 1).72	
Figure 67. Post-fire photo of experiment A3_1 (Oak/pressboard with sheet metal barrier, scenario 1). .	73
Figure 68. OD and FED values for experiment A3_1 (Oak/pressboard with sheet metal barrier, scenario 1). ....	73
Figure 69. Photo sequence for experiment B3_1 (Oak/pressboard with sheet metal barrier, scenario 1).74	
Figure 70. Pre-fire photo of experiment B3_1 (Oak/pressboard with sheet metal barrier, scenario 1). ...	75
Figure 71. OD and FED values for experiment B3_1 (Oak/pressboard with sheet metal barrier, scenario 1). ....	75
Figure 72. Average alarm time difference between Alarm type and collocated II alarm. ....	76
Figure 73. ASET computed using first or last alarm activation and time to reach 0.25 m <sup>-1</sup> or 0.50 m <sup>-1</sup> optical density limit.....	78

## List of Tables

Table 1. Alarm technology and identifying notation used in this report. ....	3
Table 2. Tabulated values of average smoke alarm sensitivity of tested alarms. ....	21
Table 3. Furniture calorimeter results for the scenarios tested. ....	22
Table 4. Photoelectric alarm activation results – frying bacon. ....	33
Table 5. Ionization alarm activation results – frying bacon. ....	33
Table 6. Dual sensor alarm activation results – frying bacon. ....	34
Table 7. Intelligent alarm activation results – frying bacon. ....	34
Table 8. Photoelectric alarm activation results – grilled cheese sandwich. ....	35
Table 9. Ionization alarm activation results – grilled cheese sandwich. ....	35
Table 10. Dual sensor alarm activation results – grilled cheese sandwich. ....	36
Table 11. Intelligent alarm activation results – grilled cheese sandwich. ....	36
Table 12. Photoelectric alarm activation results – frying hamburger. ....	37
Table 13. Ionization alarm activation results – frying hamburger. ....	37
Table 14. Dual sensor alarm activation results – frying hamburger. ....	38
Table 15. Intelligent alarm activation results – frying hamburger. ....	38
Table 16. Photoelectric alarm activation results – stir-frying vegetables. ....	39
Table 17. Ionization alarm activation results – stir-frying vegetables. ....	39
Table 18. Dual sensor alarm activation results – stir-frying vegetables. ....	40
Table 19. Intelligent alarm activation results – stir-frying vegetables. ....	40
Table 20. Photoelectric alarm activation results – broiling hamburger. ....	41
Table 21. Ionization alarm activation results – broiling hamburger. ....	41
Table 22. Dual sensor alarm activation results – broiling hamburger. ....	42
Table 23. Intelligent alarm activation results – broiling hamburger. ....	42
Table 24. Photoelectric alarm activation results – baking pizza. ....	43
Table 25. Ionization alarm activation results – baking pizza. ....	43
Table 26. Dual sensor alarm activation results – baking pizza. ....	44
Table 27. Intelligent alarm activation results – baking pizza. ....	44
Table 28. Photoelectric alarm activation results – light toast. ....	45
Table 29. Ionization alarm activation results – light toast. ....	45
Table 30. Dual sensor alarm activation results – light toast. ....	46
Table 31. Intelligent alarm activation results – light toast. ....	46
Table 32. Photoelectric alarm activation results – dark toast. ....	47
Table 33. Ionization alarm activation results – dark toast. ....	47
Table 34. Dual sensor alarm activation results – dark toast. ....	48
Table 35. Intelligent alarm activation results – dark toast. ....	48
Table 36. Photoelectric alarm activation results – very dark toast. ....	49
Table 37. Ionization alarm activation results – very dark toast. ....	49
Table 38. Dual sensor alarm activation results – very dark toast. ....	50
Table 39. Intelligent alarm activation results – very dark toast. ....	50
Table 40. Photoelectric alarm activation results – toasting bagel. ....	51
Table 41. Ionization alarm activation results – toasting bagel. ....	51
Table 42. Dual sensor alarm activation results – toasting bagel. ....	52
Table 43. Intelligent alarm activation results – toasting bagel. ....	52
Table 44. Configurations for kitchen fire tests. ....	56

Table 45. Alarm times for experiment A1_1 (Oak/pressboard, scenario 1). .....	57
Table 46. Alarm times for Experiment A1_2 (Oak/pressboard, scenario 1). .....	59
Table 47. Alarm times for Experiment A2_1 (Oak/pressboard, scenario 2). .....	60
Table 48. Alarm times for experiment A2_2 (Oak/pressboard, scenario 2). .....	62
Table 49. Alarm times for Experiment B1_1 (Laminated pressboard, scenario 1). .....	64
Table 50. Alarm times for Experiment B1_2 (Laminated pressboard, scenario 1). .....	66
Table 51. Alarm times for Experiment B2_1 (Laminated pressboard, scenario 2). .....	68
Table 52. Alarm times for Experiment B2_2 (Laminated pressboard, scenario 2). .....	70
Table 53. Alarm times for Experiment A3_1 (Oak/pressboard with sheet metal barrier, scenario 1).....	72
Table 54. Alarm times for Experiment B3_1 (Laminated pressboard with sheet metal barrier, scenario 1). .....	74
Table 55. Tabulated first and last alarm activation time and time to reach threshold smoke optical densities.....	77

DRAFT



# 1 Introduction

According to the National Fire Protection Association (NFPA), there were 1,451,500 fires reported in the United States during 2008 [1]. These fires caused 3,320 civilian fire deaths, 16,705 civilian fire injuries, and \$15.5 billion in property damage. Homes with working smoke alarms typically have a fire death rate that is about half the rate for homes with no smoke alarms or alarms that failed to operate [2]. A 2008 telephone survey by NFPA found that 96 percent of U.S. households reported having at least one smoke alarm [3]. Despite this reported high coverage, between 2003 and 2006, no smoke alarms were present or none operated in two out of five (41%) of the reported home fires. Telephone polling of U.S. households conducted in 2010 for the NFPA reported 52 percent of all respondents that had at least one smoke alarm indicated a smoke alarm was installed in the kitchen; 43 percent of the households reported a nuisance alarm within the last year; and of that 43 percent, about 75 percent indicated they thought nuisance alarms were caused by cooking activities [3]. Various randomized controlled trials—examining the prevalence of smoke alarms to remain operational after installation—identified the significance of the type of smoke alarm (photoelectric or ionization) and the location of smoke alarms to nuisance cooking sources [4–6].

Cooking appliances that initiate fires are the leading ignition sources, causing 150,000 home structure fires, leading to 500 deaths and 4,660 injuries on an annual basis (2003 to 2006 estimated yearly average) [7]. On the front line of kitchen fire safety are smoke alarms. Fires from unattended cooking or unsupervised children cooking can grow rapidly; thus, early detection from working smoke alarms is critical. Unfortunately, smoke alarms are susceptible to nuisance alarms from cooking aerosols, and they are subjected to intentional power disconnection or removal. This raises questions for consumers and even smoke alarm experts: What type of smoke alarm is present, and how far away from the kitchen (the origin of the nuisance aerosols) should it be deployed to reduce nuisance alarm frequency to tolerable levels, while maintaining a high detection capability for kitchen fires? To answer these questions specific information is needed, *e.g.*, How fast do kitchen fires grow? How quickly do hazards develop? What are the characteristics of nuisance-source aerosols for typical cooking activities? What are the alarm response characteristics to fire and nuisance aerosol exposures? Are there any new detection technologies that will improve the situation, and how will new technologies be evaluated?

There is little information on the fire growth rate and hazard development of kitchen fires. A National Institute for Standards and Technology (NIST) home smoke alarm study included a single kitchen fire scenario of a pot of cooking oil on a gas range that was heated until it ignited [8]. This particular scenario took about 20 minutes to ignite and was suppressed before any tenability limits were reached, save optical density. Smoke alarms, both ionization and photoelectric type, typically alarmed within 10 minutes of the test. The heated oil tends to fill the house with oil particle aerosols well before igniting. Mealy *et al.* conducted two kitchen cabinet fire tests as part of a National Institute of Justice grant [9]. They observed a minimum available safe egress time of greater than 135 seconds (s) for each alarm evaluated.

NIST conducted nuisance alarm tests as part of the Home Smoke Alarm study [8]. It was observed that nuisance alarms in residential settings from typical cooking activities, smoking, or candle flames are affected by the properties of the aerosol produced and its concentration, the location of an alarm relative to the source, and the air flow that transports smoke to an alarm. The study provides a detailed set of data that has been used to address several issues involving nuisance alarms and reinforces current suggested

practices. Clearly, the advice that alarms not be installed close to cooking appliances, if at all possible, is valid. The results suggested that homeowners who are able to move the location of an alarm that frequently experiences nuisance alarms would do well to maximize its distance from cooking appliances while keeping it in the area to be protected. It was observed that ionization alarms had a propensity to alarm when exposed to nuisance aerosols produced in the early stages of some cooking activities, prior to noticeable smoke production. This phenomenon could be particularly vexing to homeowners who experience such nuisance alarms.

The CPSC conducted an experimental study of the frequency and causes of residential cooking nuisance alarms by monitoring several smoke alarms near kitchens in nine households for 30 days [10]. The alarm states of photoelectric, ionization, and dual-sensor photoelectric/ionization alarms with disabled sounders were monitored, and alarm times were recorded. Additionally, occupants were instructed to record cooking activities and any time existing household alarms activated. The results showed a considerable reduction in nuisance alarms as the distance from the cooking appliance increased from 1.5 m to 6.0 m. Dual-sensor alarms tend to respond more frequently than photoelectric or ionization alarms. Additionally, certain types of cooking activities, like sautéing, pan frying, and stir frying tended to cause more nuisance alarms.

The National Fire Alarm and Signaling Code, NFPA 72, addresses the issue of nuisance alarms in household smoke alarms by specifying alarm location rules within 6 m (20 ft) of the horizontal distance, as measured from a ceiling location above a fixed cooking appliance to the smoke alarm [11]. Simply stated, no smoke alarms shall be installed within 3 m (10 ft) of a ceiling location above a fixed cooking appliance, and between 3 m (10 ft) and 6 m (20 ft), smoke alarms must use photoelectric detection, or have a means of temporarily silencing the alarm. An exception is specified for placement of photoelectric smoke alarms within 1.8 m (6 ft), where the 3 m exclusion would prohibit placement of a smoke alarm required by other sections of the code. The efficacy of these location rules needs to be judged on the basis of expected nuisance alarm reduction and adequate detection of kitchen fires. The fact is, only a limited amount of research was available to construct these rules, with a belief that some decrease in nuisance alarms and subsequent decrease in alarm disabling would improve safety. Quantitative evaluation of smoke alarm performance of kitchen fire detection and cooking nuisance source rejection would verify expected improvement when the location rules are followed. In addition, advances in smoke alarm technology have led to new products that have been designed to address detection and nuisance alarm problems. These products have no measured performance history regarding nuisance alarm rejection. The performance of any new product designed to perform within the 6 m (20 ft) zone is not resolved.

The research presented in this report focuses on alarm performance under various cooking nuisance source exposures and cooking fire scenarios. Existing alarm technologies and newer advanced smoke alarms were included in the research. Particular attention was given to the fire hazard development of kitchen fires that start off initially slow and grow to involve an overhead cabinet to provide some insight into how fast certain kitchen fires grow and how quickly hazards develop.

## 2 Experimental Plan

The experimental plan consists of measuring the sensitivity of various residential smoke alarms in the NIST fire emulator/detector evaluator (FE/DE), then subjecting them to nuisance source exposures from cooking activities to document the propensity to nuisance alarm, and to kitchen fires to assess their performance in kitchen fire scenarios. Nuisance source exposures and kitchen fire tests were conducted in a small apartment mock-up. This example of living space represents only a fraction of households, but it presents significant challenges regarding nuisance alarms and hazard development during fires due to its relatively small square footage. Additionally, tests were performed to measure the heat release rate of the two ignition scenarios and cabinet constructions used in the kitchen fire tests. These tests were performed in the NIST furniture calorimeter.

Smoke alarms were selected from current retail stock, employing photoelectric or ionization single-sensor technology, photoelectric and ionization dual-sensor technology, and multisensor, intelligent alarm technology. Intelligent alarm technology is distinguished by the use of an algorithm to process sensor signals to determine the alarm condition. The intelligent alarms currently available pair ionization sensors with carbon monoxide gas or humidity sensors. Table 1 lists the technology for each alarm and the identifying notation used in the rest of the report.

Technology	Notation
Photoelectric	P1
Photoelectric	P2
Ionization	I1
Ionization	I2
Dual sensor photoelectric/ionization	D1
Dual sensor photoelectric/ionization	D2
Multisensor, intelligent alarm	M1
Multisensor, intelligent alarm	M2

Table 1. Alarm technology and identifying notation used in this report.

## 2.1 Smoke Alarm Sensitivity Test Protocol

The NIST fire emulator/detector evaluator, FE/DE, was used to produce smoldering cotton wick smoke at various concentration levels to which the various smoke alarms were exposed. A schematic of the FE/DE is shown in Figure 1. The cotton wick is the same material used in UL 217 for the smoke alarm sensitivity test [12]. The FE/DE cotton wick igniter was used to provide stepwise concentrations of smoke. At the test section, laser light extinction beam (635 nm wavelength) was used to measure the light extinction of the smoke. The laser light travels across the duct, 5 cm below the duct ceiling, and reflects off mirrors to increase the path length through the duct smoke. A reference measuring ionization chamber (MIC) was installed on the ceiling of the test section. The MIC responds in a similar manner to ionization chambers inside smoke alarms. The MIC output current is reduced when smoke is present, and the reduction is related to the smoke concentration. The output current is nominally 100 pA in clean air.

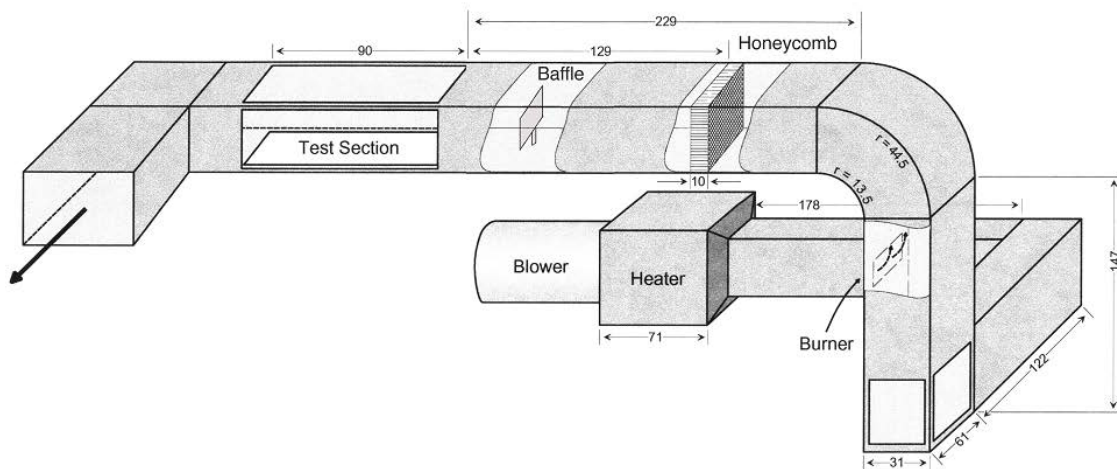


Figure 1. Schematic of the NIST fire emulator/detector evaluator (units in cm).

Since the FE/DE is a single-pass flow device, the smoldering smoke does not get a chance to age for a long time before it reaches the test section. In contrast, the UL217 smoke box has a recirculating flow path; thus, the smoke is aged to some degree. Aging affects the average smoke particle size, which, in turn, affects alarm response. The smoke sensitivity test limits specified by UL 217 Standard, in terms of a comparison of the light transmittance through a 1.5 m path length of smoke to the MIC output current, are presented as two dashed curves in Figure 2. The area between the curves represents expected smoke characteristics. During a sensitivity test, to be considered a valid test, all measured values of light transmittance and MIC current must fall within the bounds of the two curves. Typical measures for the FE/DE cotton wick smoke are shown in Figure 2 as averaged steady smoke values with error bars representing  $\pm$  one standard deviation for both transmittance and MIC current averages. The values fall within the valid region for the majority of the measurements and stray outside the dashed lines for MIC values less than 50 pA.

The smoldering cotton produces carbon monoxide (CO) in addition to smoke particles. Figure 3 shows the CO concentration as a function of the MIC current for different steady wick burning periods as

measured at the FE/DE test section. A non-dispersive infrared carbon monoxide gas analyzer was used to measure the CO concentration from gas samples extracted from the FE/DE test section through a sampling line. The analyzer has a resolution of  $1 \times 10^{-6}$  volume fraction (ppm volume) and an uncertainty on that order. The plotted error bars represent  $\pm$  one standard deviation of the fluctuating measurements. For intelligent multisensor smoke alarms that use CO sensing, the concentration in the smoke sensitivity test may impact alarm conditions, and thereby, the smoke concentration at alarm.

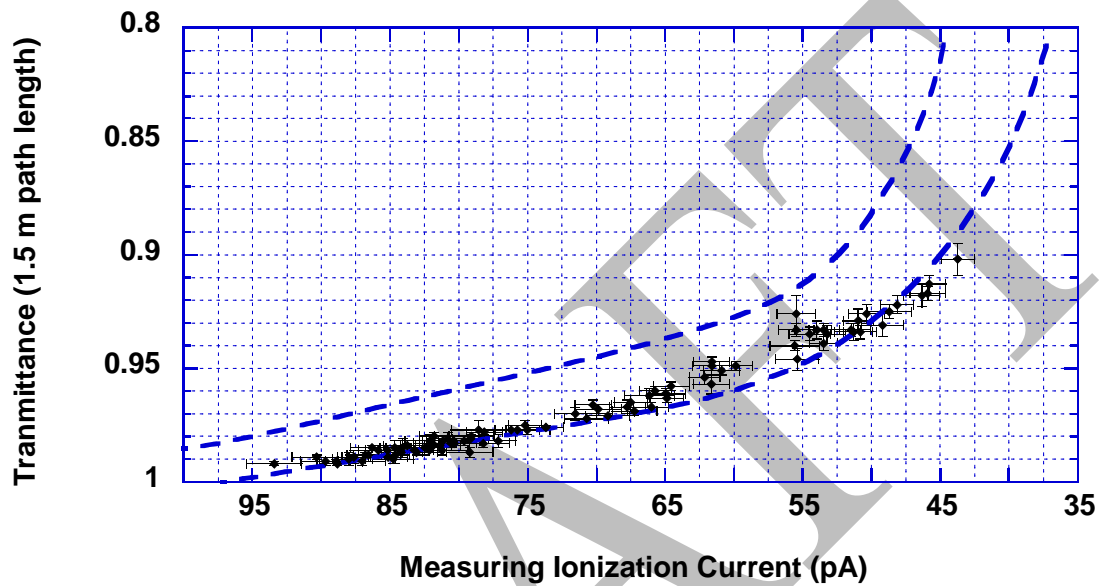


Figure 2. Smoke sensitivity test limits for UL217. Data points are measured values from the FE/DE smoldering cotton smoke.

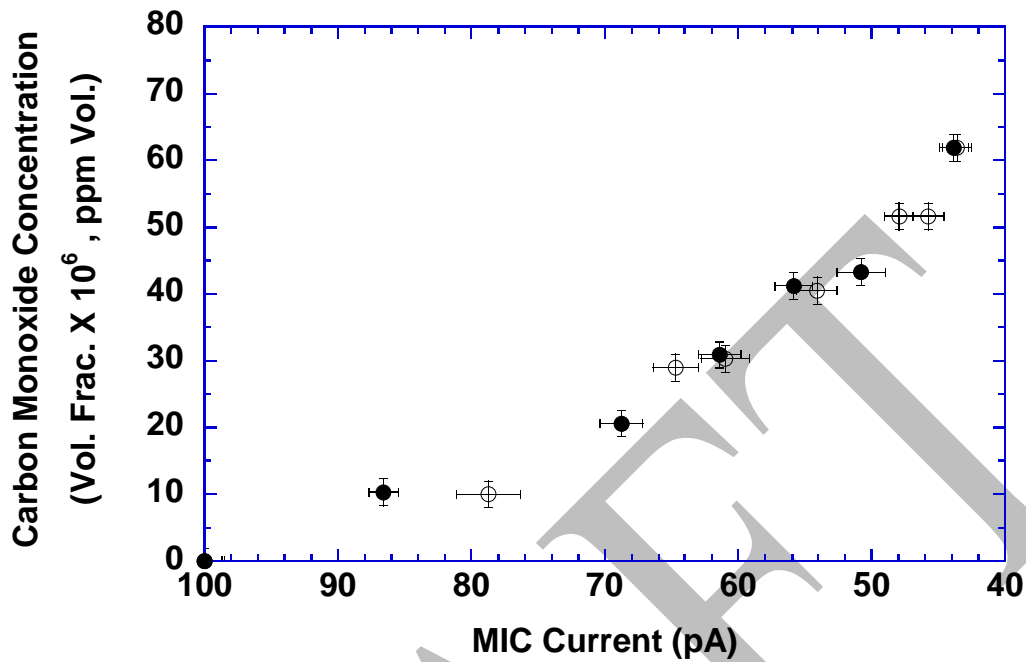


Figure 3. CO concentration versus MIC current for steady cotton wick burning periods. Open and closed symbols represent different sets of wicks.

Identical make and model smoke alarms were placed side-by-side on the ceiling of the test section, just behind the extinction beams, and 15 cm in front of the MIC. The sensing chambers of the installed smoke alarms were oriented between the best- and worst-case orientations for smoke entry. All smoke alarms were powered by battery, and the smoke alarm battery voltage was used to determine if an alarm was activated. The alarm state was determined by the smoke alarm battery voltage drop and compared to the smoke extinction and measuring ionization chamber results.

The midpoint between the non-alarm and alarm smoke extinction or measuring ionization chamber values is used as the estimate of the alarm sensitivity. For example, Figure 4 shows a typical graph of MIC current and the laser beam transmittance versus time for an ignition sequence of six sets of wicks. During ignition of a set of wicks, the smoke production is elevated and the MIC current and laser beam transmittance drop sharply. The wicks in the ignited set then approach a steady burning rate and both the transmittance and the MIC current reach a plateau. Consecutive sets of wicks are ignited and add to the smoke concentration as the previously ignited wicks continue to burn.

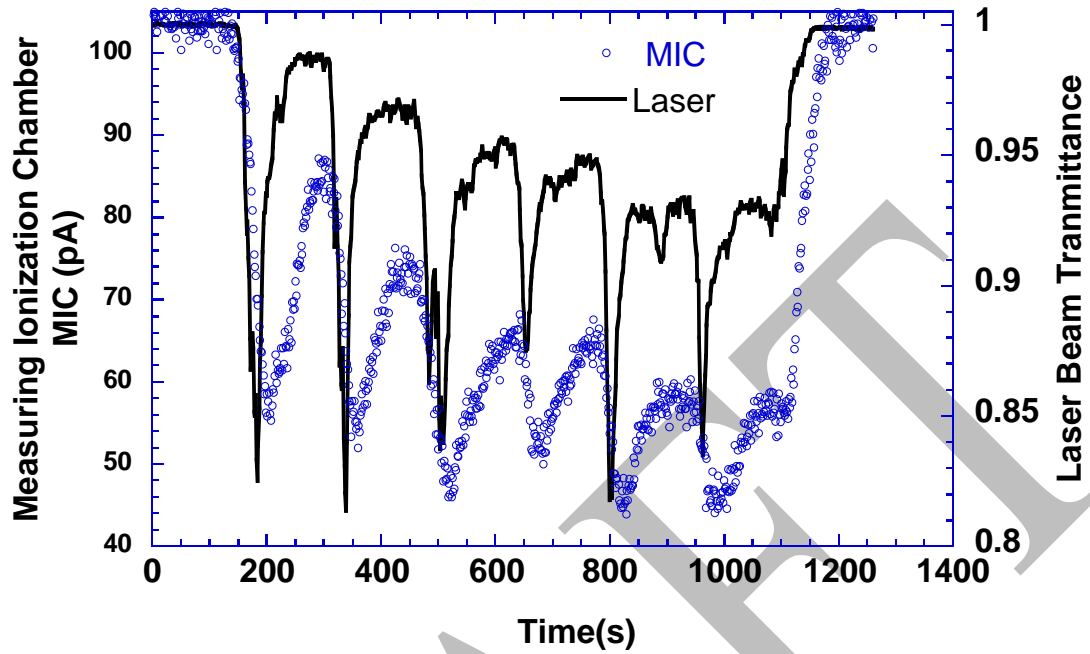


Figure 4. MIC current and laser transmittance for an ignition sequence of six sets of wicks

Figure 5 shows an expanded view of this time period. Assuming an alarm was not active prior to the ignition of the 5<sup>th</sup> set of wicks and was active prior to the ignition of the 6<sup>th</sup> set of wicks, a midpoint value of the MIC current or transmittance between the 4<sup>th</sup> and 5<sup>th</sup> set of wicks just prior to ignition of the next set of wicks is used to estimate the alarm sensitivity. Interval 1 (30 s prior to ignition of the 5<sup>th</sup> set of wicks) has an average MIC current of 64.4 pA with a standard deviation of 1.2 pA, and an average transmittance of 0.948 with a standard deviation of 0.001. Interval 2 (30 s prior to ignition of the 6<sup>th</sup> set of wicks) has an average MIC current of 57.6 pA with a standard deviation of 1.5 pA, and an average transmittance of 0.930 with a standard deviation of 0.003. Thus, the average MIC current is 61.0 pA, and the average transmittance is 0.939. Repeated sensitivity test results are averaged.

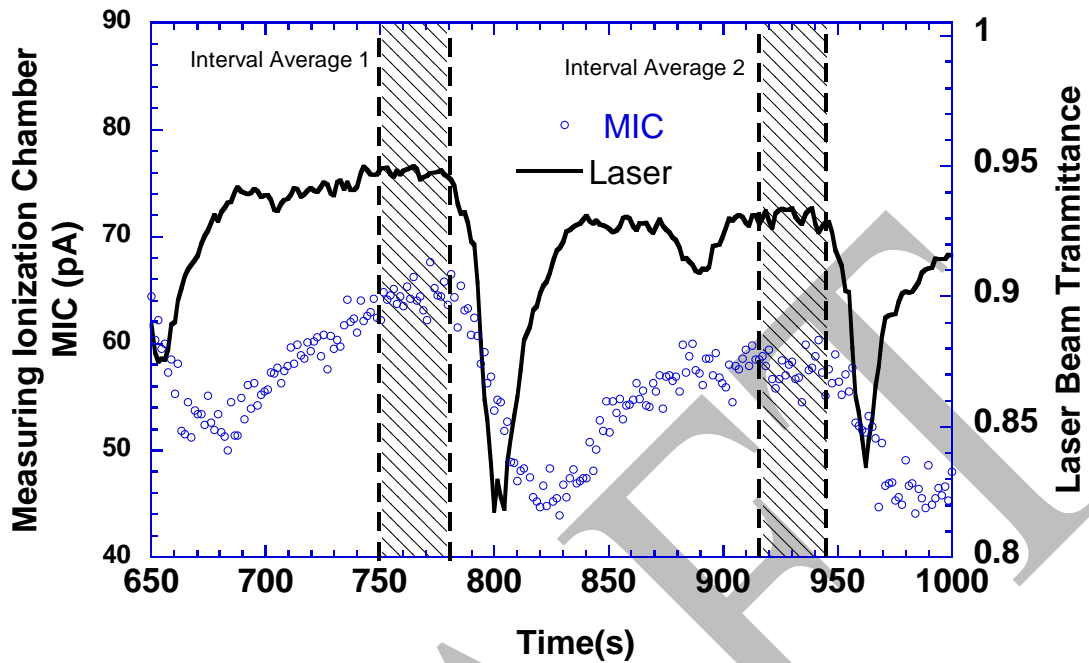


Figure 5. An expanded view of the MIC current and laser beam transmittance for the 4<sup>th</sup> and 5<sup>th</sup> set of wicks. The interval averages 1 and 2 represent the steady wick smoke concentration levels.

## 2.2 Fire Scenario Designs and Heat Release Rate Measurement

Range top initiated kitchen fires are the most prevalent in the U.S. national fire statistics [7]. Unattended range top cooking fires can initiate and grow unnoticed prior to a smoke alarm alerting or being discovered by an occupant. Food items are most likely the materials first ignited in a range top fire, followed by fire spread to adjacent items. Extended heating of solid food to the point where it chars and ignites, or cooking oils to the point where they reach their ignition point are potential fire sources. However, such fires may not represent significant challenges to smoke alarms due to the extended production of smoke prior to ignition that tends to activate local smoke alarms well before hazardous conditions. A more challenging fire scenario is direct ignition of combustibles from a stove-top heating element because smoke production and the establishment of a flaming fire essentially begin at the same time. The fire scenario chosen here begins with ignition of a roll of paper towels on the counter adjacent to the range heating element, followed by subsequent ignition of various items on the counter top, and the spread of fire to an overhead wall cabinet.

Two cabinets and two ignition scenarios were investigated. The two cabinets were identical in size, 61 cm wide x 76 cm high x 30 cm deep (30 in. x 24 in. x 12 in.) but with different materials of construction. The first cabinet was unfinished and had a solid oak frame with oak door panels and pressboard top, bottom, interior shelf, and side panels. The second cabinet was constructed from pressboard with a thin plastic veneer finish. It contained one interior shelf. During all tests, the cabinets were empty, except for the shelf board.



The ignition scenarios consisted of two different fixed arrangements of combustible materials. The first arrangement consisted of a roll of paper towels sitting on a stack of five 25 cm diameter foam polystyrene disposable plates, adjacent to a 300 g bag of potato chips, and a small plastic electric drip coffee maker. Figure 6 shows the arrangement of the combustibles underneath the cabinet and adjacent to the range location. For the fire tests, the range was replaced with a frame of cement board and a 1kW electric heating element to simulate an electric range. The roll of paper towels was unraveled and the paper towel end was draped over the heating element.

The second arrangement (Figure 7) consisted of a roll of paper towels sitting on a stack of ten 25 cm diameter foam polystyrene disposable plates, adjacent to a bag of corn chips, a box of breakfast cereal, a bag of potato chips, and a box of microwave popcorn. On the counter in front of the paper towels was a rigid plastic plate with five paper towels on top that were soaked with 100 ml of cooking oil. In addition, a cotton rag soaked with 50 ml of cooking oil was draped over the counter and onto the range mock-up. Identical to the first ignition scenario, the roll of paper towels was unraveled and the paper towel end was draped over the heating element.

The ignition sequence was initiated by applying power to the electric heating element. Once the heating element reached a high enough temperature, the paper towel end ignited and spread to the entire roll, flames spread to the different combustibles, and eventually impinged on the bottom of the cabinet.

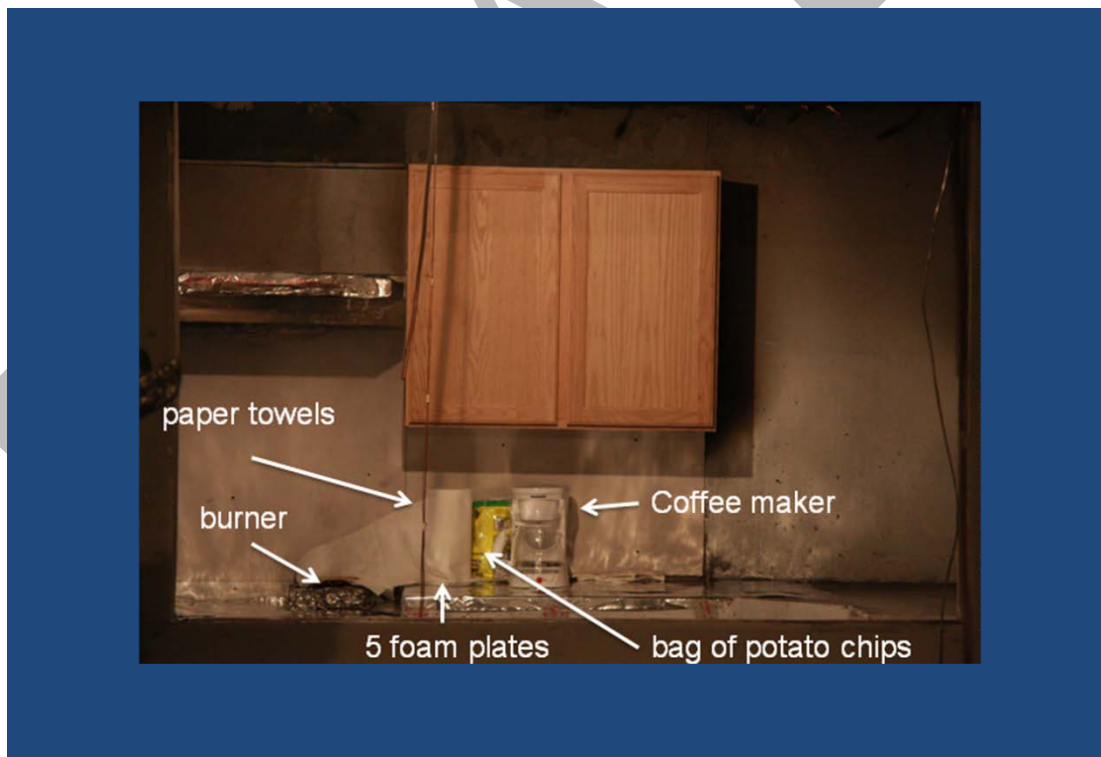


Figure 6. Configuration for ignition scenario 1.

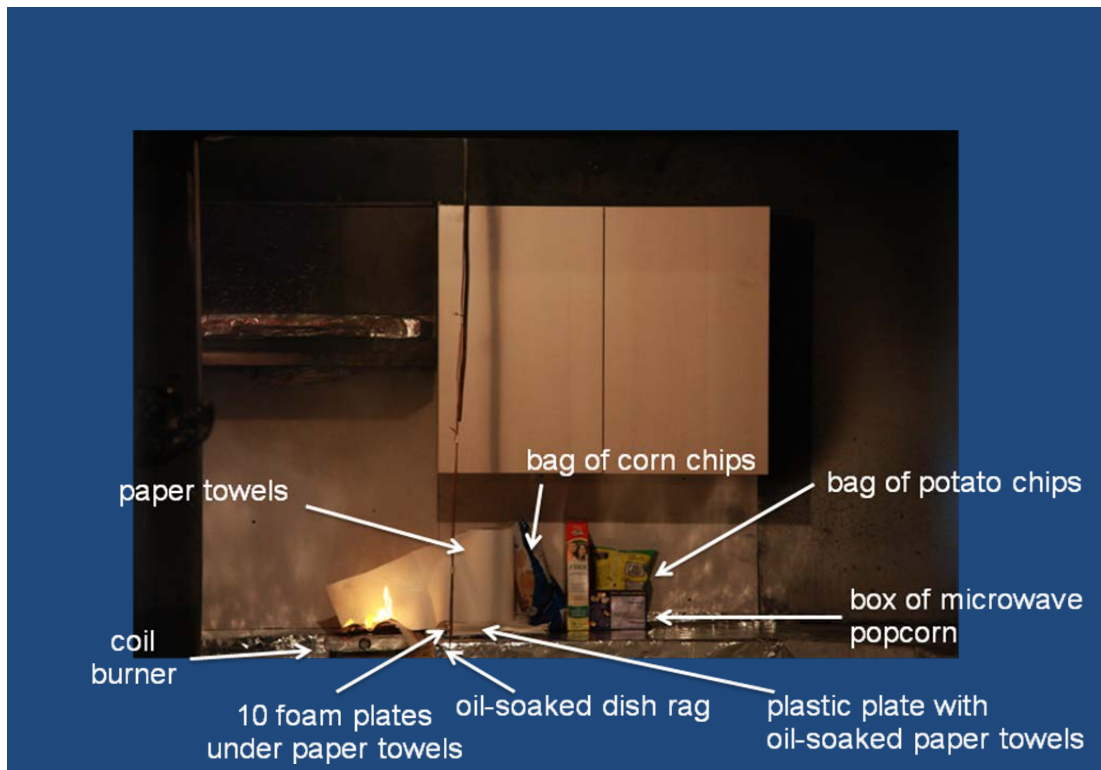


Figure 7. Configuration for ignition scenario 2.

Additional tests were conducted with a sheet metal barrier placed on the bottom and partially up the side of the cabinet facing the range. The intent of the barrier was to protect the cabinet from impinging flames in order to slow down or eliminate the ignition of the cabinet. Figure 8 shows how the sheet metal was installed on the cabinet. This limited protective layer was intended as a surrogate of an esthetically pleasing barrier built into the cabinet. The kitchen fire tests used aluminum sheet metal, while the furniture calorimeter tests used a galvanized steel sheet metal barrier.



Figure 8. Sheet metal barrier on bottom and side of wall cabinet.

A portable mockup of the kitchen section was placed on weighing scales setup under a 3x3 m heat release rate hood in the NIST National Fire Research Laboratory. The furniture calorimeter has a 1MW capacity and was calibrated prior to each series of tests (4 tests per day) with natural gas calibration burner. The standard 5-point natural gas calibration is performed at 75/150/200/350/500 kW fuel flow presets to determine calibration factors. The combined standard uncertainty of heat release rate for an unspecified fuel was estimated at  $\pm 8\%$ , and the combined standard uncertainty of the total heat release was estimated at  $\pm 5\%$  due to the uncertainty in the heat of combustion of mixed fuel items [13]. Fire-resistant cement board panels were used to create countertop, supporting back wall, a simulated range cabinet over-the-range hood, and the ceiling section. Gypsum board was attached to the supporting back wall, and the cabinet was attached to the gypsum board. Figure 9 shows the arrangement. The gypsum board sections were replaced after each test. Tests were also conducted with a cement board mock-up of the cabinet to assess the heat release rate without the cabinet.



Figure 9. Kitchen counter and cabinet mock-up. The counter level rests on load cells, and the entire mock-up fits under the furniture calorimeter hood.

## 2.3 Full-Scale Tests

### 2.3.1 Test Structure

Full-scale tests were conducted at the Montgomery County Fire and Rescue Service Public Training Academy. A section of the burn prop building (Figure 10) was used to conduct the experiments.



Figure 10. Exterior view of the burn prop building.

A kitchen, living room, hallway mock-up was arranged in a section of the first floor of the burn prop building. Figure 11 is a schematic of the mock-up. In this arrangement, the hallway is envisioned to lead to additional rooms. The opening on the right-side wall was an access doorway into the structure; there was another door opening from the kitchen to the outside of the burn prop building that was used to ventilate the mock-up after tests. The kitchen has two access openings and a wide window-style opening looking out into the living room. All three openings had the same soffit depth from the ceiling (30 cm). The schematic shows the location of thermocouple trees (TC Tree), gas sampling (Gas Analyzer), and Laser Extinction meters (Laser). Figure 12 is a picture of the kitchen layout looking through the kitchen/living room opening.

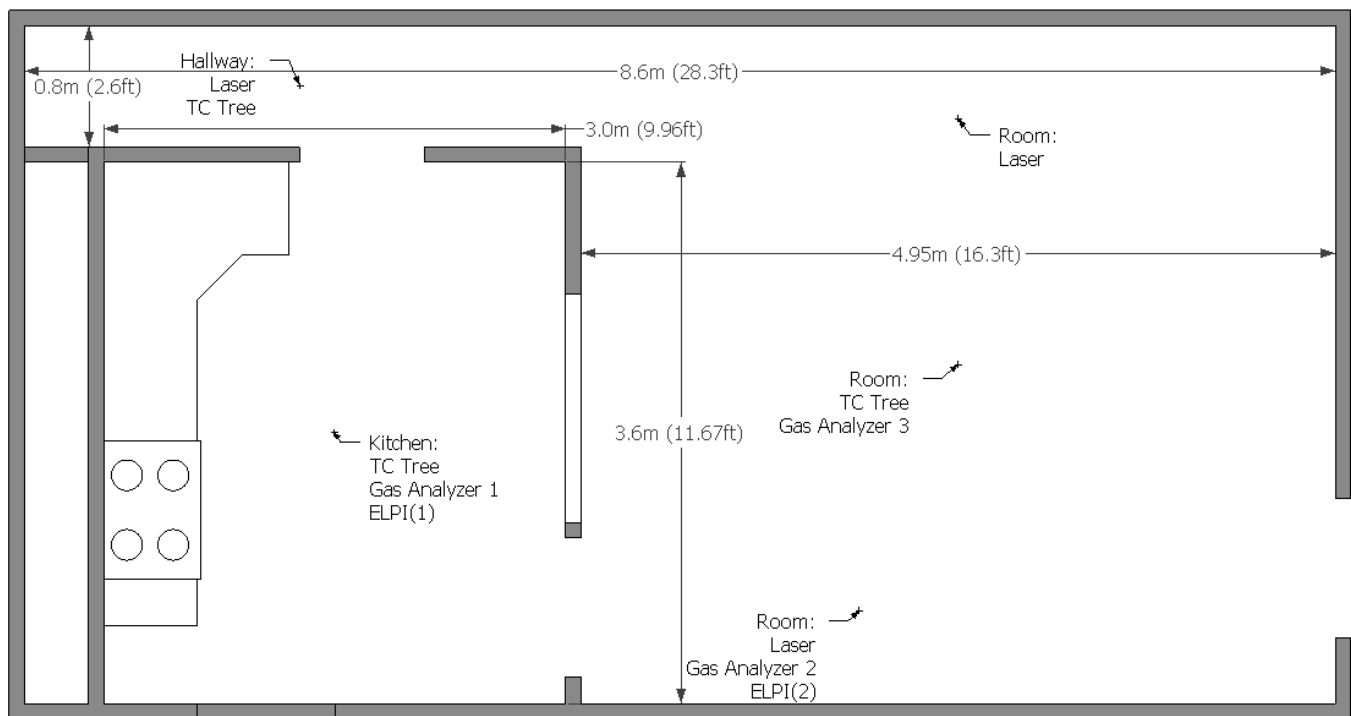


Figure 11. Schematic of the living space mock-up.



Figure 12. Picture of the kitchen counter and cabinet mock-up.

### 2.3.2 Measurement Equipment

The mock-up was instrumented with gas sampling tubes, thermocouples, laser extinction meters, and smoke alarms that were monitored for alarm state. Figure 13 shows the view looking from the access door into the kitchen. The positioning of three smoke alarm boards is shown. The individual smoke alarms are obscured. A laser extinction meter and a gas sampling tube are visible below the smoke alarms. The laser extinction meter and the gas sampling tube were positioned at 1.5 m from the floor, a standard height for tenability evaluation. The combined standard uncertainty of the laser extinction meter was estimated at  $\pm 10\%$  of the recorded optical density. The combined standard uncertainty of both the CO and CO<sub>2</sub> gas concentration measurements was estimated at  $\pm 5 \times 10^{-4}$  volume fraction.



Figure 13. Picture showing alarm placements, extinction meter, sampling tubes, and window and door openings.

The alarm state of each smoke alarm was estimated from battery voltage measurements. Each smoke alarm shows a distinct drop in the battery voltage when the buzzer is sounding. This voltage drop is indicative of a sounding alarm. The estimated uncertainty in the reported time to alarm is  $\pm 1$  s.

### 2.3.3 Nuisance Alarm Test Protocols

Cooking activities—toasting, frying, baking, and broiling—were selected to represent a range of potential cooking nuisance sources. The CPSC study [10] guided the selection of the sources. These sources were also used in previous cooking source experiments at NIST [14].



## Toasting bread

Toasting bread experiment consisted of two slices of white bread being placed in a two-slice toaster. The automatic pop-up function of the toaster was disabled. Two slices of white sandwich bread were placed in the toaster, and 120 s after the start of the data acquisition computer, power was applied to the toaster. The bread was toasted for a fixed period of time, and then the toaster was powered off. Three separate toasting times were specified 105 s, 185 s, and 220 s, representing light, dark, and very dark toast (burnt), respectively. No one was in the test room during these experiments. Figure 14 shows the location of the toaster on the counter space and representative toasted bread samples for the three toasting times.



Figure 14. Toasting bread configuration and toasted bread exemplars.

## Toasting bagel

The toasted bagel experiments consisted of one regular/frozen bagel cut in half and each half toasted in the two-slice toaster. The automatic pop-up function of the toaster was disabled. The bagel was toasted for 240 s, then the toaster was powered off. No one was in the test room during these experiments.

Figure 15 shows a representative sample of a toasted bagel.



Figure 15. Toasted bagel exemplar.

#### Frying bacon

The frying bacon experiment consisted of frying six strips of bacon in a 25 cm diameter nonstick-coated frying pan on a 19 cm diameter 1.1 kW electric coil burner on the range. The range burner was turned on to the highest heat setting for 60 s after the start of the data acquisition computer. The bacon was stirred and turned for the next 380 s, fully cooking the bacon to a crispy texture. The frying pan was removed from the range and the heat turned off. Figure 16 shows representative before and after images of the bacon.

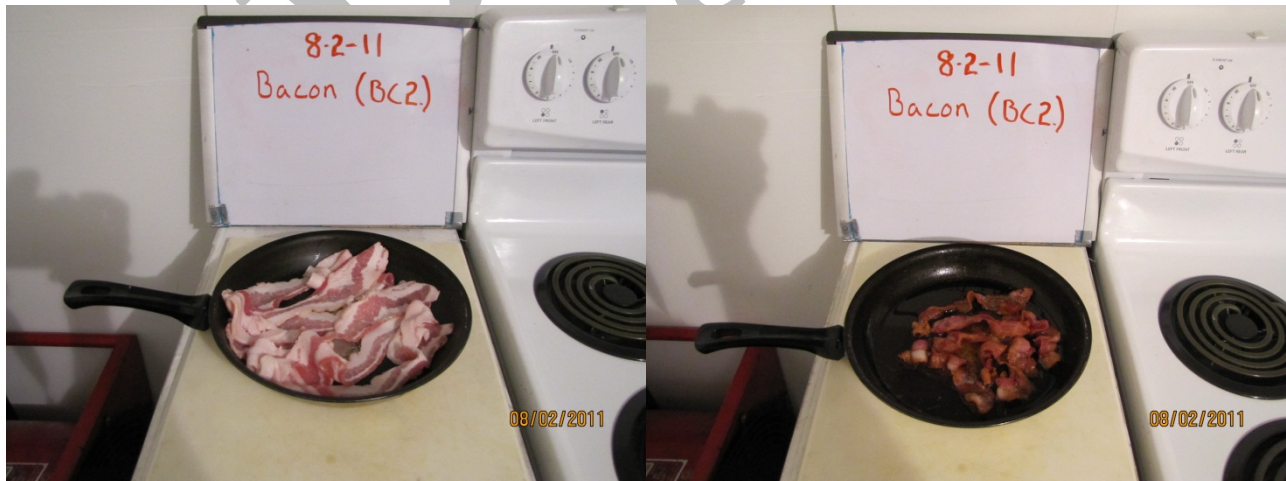


Figure 16. Frying bacon configuration and fried bacon exemplar.



## Frying hamburger

The fried hamburger experiment consisted of one frozen beef hamburger patty placed in a 25 cm fry pan and heated on a 19 cm diameter 1.1 kW electric coil burner on the range. After 60 s of background data collection, the coil burner on the range was set to the high heat setting (10), and the frying pan with the hamburger was placed on the burner. After 180 s, the heat was reduced to a medium setting (6), 150 s later, it was flipped to the uncooked side. The hamburger was allowed to cook for an additional 180 s, at which time the heat was shut off and the frying pan removed from the range. Figure 17 shows before and after images of the hamburger.



Figure 17. Frying hamburger configuration and fried hamburger exemplar.

## Broiling hamburger

The broiling hamburger experiment consisted of broiling a frozen beef hamburger patty using a broiler pan placed on the top oven rack of an electric range. After 60 s of background data collection, the broiler pan with the hamburger was placed in the oven with the oven door left cracked approximately 11.5 cm and the oven set to broil. After 600 s, the oven door was opened, and the hamburger was flipped. The door was then returned to its cracked open position, and the hamburger was left to broil another 240 s. The hamburger and broiler pan were removed and the broiler turned off. Figure 18 shows before and after images of the patty.



Figure 18. Broiling hamburger configuration and broiled hamburger exemplar.

### Grilled Cheese Sandwich

The grilled cheese sandwich experiment consisted of two slices of white sandwich bread, buttered on the outside, with two slices of American cheese inside, placed in a 25 cm diameter frying pan and heated on a 19 cm 1.1 kW electric coil burner on the range. After 60 s of background data collection, the coil burner on the stove was set to the high heat setting (10), and the frying pan with the sandwich in it was placed on the burner. After 180 s, the heat was reduced to a medium-high setting (7), and the sandwich was flipped over. The sandwich was allowed to cook for another 100 s, at which time the heat was shut off, and the frying pan removed from the range. Figure 19 shows the set up and the prepared sandwich.



Figure 19. Grilled cheese sandwich configuration and prepared sandwich exemplar.

## Vegetable Stir-Frying

The vegetable stir-frying experiment consisted of chopping up one carrot, one onion, and one celery stalk and frying them in a 27.5 cm diameter steel wok pan with 10 ml of vegetable oil. After 60 s of data collection, 15 ml of vegetable oil was poured into the wok pan on the front 19 cm coil burner, which was then set to a high heat setting (10). After heating the vegetable oil 140 s, the carrots, onions, and celery were stirred together in the wok pan. A continuous stirring action occurred for 165 s, at which time the heat was turned down to a medium setting (6). Stir-frying continued for 140 s longer, and then the wok pan was removed from the range. Figure 20 shows the chopped vegetables before and after cooking.



Figure 20. Stir-fry vegetables before and after cooking.

## Baking Pizza

The baking pizza experiment consisted of baking a small, individual-size pepperoni pizza (6.5 oz.) in the electric range oven. Prior to placing the pizza in the oven, the oven was preheated to a setting of 450° F. After collecting 60 s of background data, the oven door was opened, and the pizza was placed directly on the mid-level oven rack. The oven door was closed, and the pizza was allowed to bake for 600 s. At the end of the 600 s cooking time, the oven door was opened, and the pizza was removed. The oven door remained open for a total of 30 s, then the door was closed, and the oven was turned off. Figure 21 shows representative images before and after cooking a pizza.





Figure 21. Baking pizza configuration and cooked pizz

### 2.3.4 Kitchen Fire Experimental Protocols

The kitchen fire tests were the same as the fire scenarios tested in the furniture calorimeter, namely the ignition of counter space items from an electric range heating element. The two cabinet designs and two ignition scenarios were tested twice. Data collected during the kitchen fire tests consisted of alarm state of smoke alarms at various locations, smoke light extinction at three locations at a height of 1.5 m from the floor, temperature measurements from thermocouple trees at three locations, and combustion gas sampling at two locations at a height of 1.5 m from the floor. Additionally, carbon dioxide and carbon monoxide were measured in the kitchen at the ceiling location to capture early combustion gases from the fires.

Figure 22 shows the configuration of the kitchen fire tests. The base cabinet mock-ups were constructed from cement board, as well as the two wall cabinets located to the left of the test cabinet. A typical metal range vent hood was installed above the location of the mock-up range, abutting the test cabinet. The range and counter surfaces were covered with aluminum foil to aid with post-test clean up.



Figure 22. Configuration of kitchen counter and cabinet with ignition scenario 1 shown.

### 3 Results and Analysis

#### 3.1 Smoke Alarm Sensitivity Measurements

The smoke alarm sensitivity measurements provide a reference sensitivity range of different smoke alarm types, relative to cotton smolder smoke. Smoke alarms of the same make and model were placed side-by-side on the ceiling of the FE/DE test section. The positions were labeled front and back. The alarm locations were swapped after three tests, and the average results from each location were computed. While the measuring ionization chamber samples from the centerline of the FE/DE duct, the extinction measurement across the duct is an average of the smoke across the duct at a particular height. A persistent concentration gradient in the duct would tend to bias the results, based on location of the smoke alarm.

The results for each tested smoke alarm type are given in Table 2. Results are provided in terms of MIC current and smoke obscuration (%/ft per UL reporting and labeling convention).

Alarm	Position	MIC (pA)	Std Dev (pA)	Avg MIC (pA)	Std Dev (pA)	Obsc. (%/ft)	Std Dev (%/ft)	Avg Obsc. (%/ft)	Std Dev (%/ft)
I1	front	87.2	1.8	87.6	1.8	0.24	0.02	0.22	0.03
	back	87.9	1.9			0.21	0.03		
I2	front	82.4	1.2	81.9	1.4	0.32	.06	0.33	0.06
	back	81.5	1.5			0.34	0.06		
P1	front	52.3	5.6	50.7	4.2	1.42	0.29	1.50	0.23
	back	49.2	1.2			1.58	0.12		
P2	front	54.3	4.3	54.8	3.8	1.33	0.17	1.29	0.14
	back	55.2	3.6			1.26	0.12		
D1	front	73.6	4.3	72.6	3.9	0.54	0.10	0.57	0.13
	back	71.7	3.7			0.60	0.15		
D2	front	80.5	2.1	82.7	2.9	0.35	0.06	0.30	0.08
	back	85.0	1.3			0.24	0.05		
M1	front	65.4	2.2	65.4	1.7	0.78	0.11	0.78	0.09
	back	65.3	1.3			0.78	0.08		
M2	front	82.2	3.6	82.5	2.5	0.30	0.07	0.29	0.05
	back	82.9	1.0			0.28	0.03		

Table 2. Tabulated values of average smoke alarm sensitivity of tested alarms.

It was observed that the difference between the front and back position average MIC current ranged from 0.1 pA to 4.5 pA. In most cases, the average front and back MIC current for like alarms fall within the other position's standard deviation. An exception is D2, where the difference between the means is greater than one standard deviation. The average MIC current and obscuration sensitivity, including all front and back alarm position results were computed and are listed in the table. The alarm with the highest sensitivity to the cotton smolder smoke is I1, and the alarm with the lowest sensitivity is P1. The relative sensitivities to other smoke sources would vary, depending on the smoke characteristics.

### 3.2 Fire Scenario Heat Release Rates

Each fire scenario and cabinet construction was tested in the NIST furniture calorimeter to determine the heat release rate (HHR) as the fire progressed until it was extinguished or ceased flaming. In addition to the cabinet constructions and sheet metal barriers, noncombustible cement board cabinet mock-ups were tested to determine the heat release rate of the countertop objects by themselves. Each test was conducted once.

The furniture calorimeter is capable of measuring the heat release rate of furniture-sized objects burning under its exhaust hood. The details of the heat release rate calorimetry can be found in reference [13]. The combustion environment in the furniture calorimeter differs from those found in room enclosures. There is plenty of fresh air entrained into the fire plume in the free-burning conditions of the furniture calorimeter. In a room environment, as a fire progresses, the oxygen concentration decreases, creating a vitiated environment, typically reducing the burning rate. Combustion in the vitiated room environment leads to increased carbon monoxide concentrations. On the other hand, a hot gas layer that develops in a room environment will radiate heat and tend to increase the burning rate of objects. The furniture calorimeter removes the combustion gases via the exhaust flow, eliminating hot gas layer. Thus, the early fire development in the furniture calorimeter and a room configuration will tend to match more closely than later. Table 3 gives the measured peak heat release rate and the total heat release for each experiment.


Test Name	Cabinet Construction	Ignition Scenario	Peak Heat Release Rate (kW)	Total Heat Release (MJ)
A1	Oak/Pressboard	1	672	206*
B1	Laminated Pressboard	1	239	65
A1B	Oak/Pressboard, Sheet Metal Barrier	1	111	40
B1B	Laminated Pressboard, Sheet Metal Barrier	1	177	44
A2	Oak/Pressboard	2	107	31
B2	Laminated Pressboard	2	122	29
CB1	Cement Board	1	55	31
CB2	Cement Board	2	59	24

\*Fire extinguished approximately 1100 s after ignition

Table 3. Furniture calorimeter results for the scenarios tested.

The oak/pressboard cabinet ignited with ignition scenario 1 (A1) was essentially completely combusted. The sheet metal barrier (A1B) significantly reduced the peak heat release rate and effectively stopped complete fire propagation to the cabinet. The laminated pressboard cabinet subjected to ignition scenario 1 (B1) experienced the next highest peak heat release rate, and the sheet metal barrier test (B1B) produced a reduced heat release rate. Ignition scenario 2 produced significantly lower peak heat release rates for both cabinet types compared to ignition scenario 1. The cement board tests (CB1 and CB2) reveal differences between the ignition sources themselves. The peak heat release rates are similar. The total heat release from CB1 is approximately 30 percent higher than CB2, which reflects the substantial contribution of the plastic coffee maker.

The heat release rate curve along with a sequence of images showing the fire growth stages are presented in the following figures (23–38). The start time (time = 0) of the heat release rate curve was when the electric hot plate was energized. There was approximately a 100 s elapsed time before the paper towel ignited in each test. Ignition is evident in the initial increase in heat release rate from zero. The picture sequence represents before ignition in the upper left photo, the fire at the peak heat release rate value in the lower left photo, the fire progression at  $\frac{1}{2}$  the time to reach the peak heat release rate in the upper right photo, and the end of the test in the lower right photo.

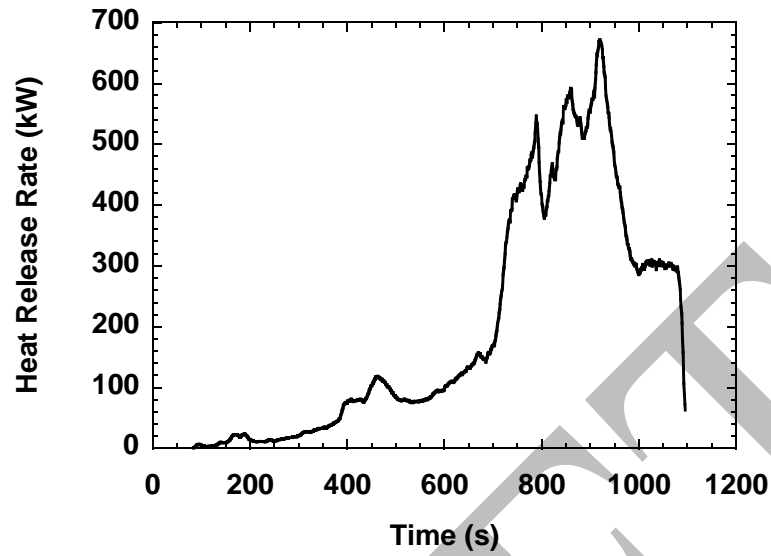

Fire extinguished with water spray at approximately 1100 s

Figure 23. Heat release rate for Test A1 - Oak/pressboard exposed to ignition scenario 1.

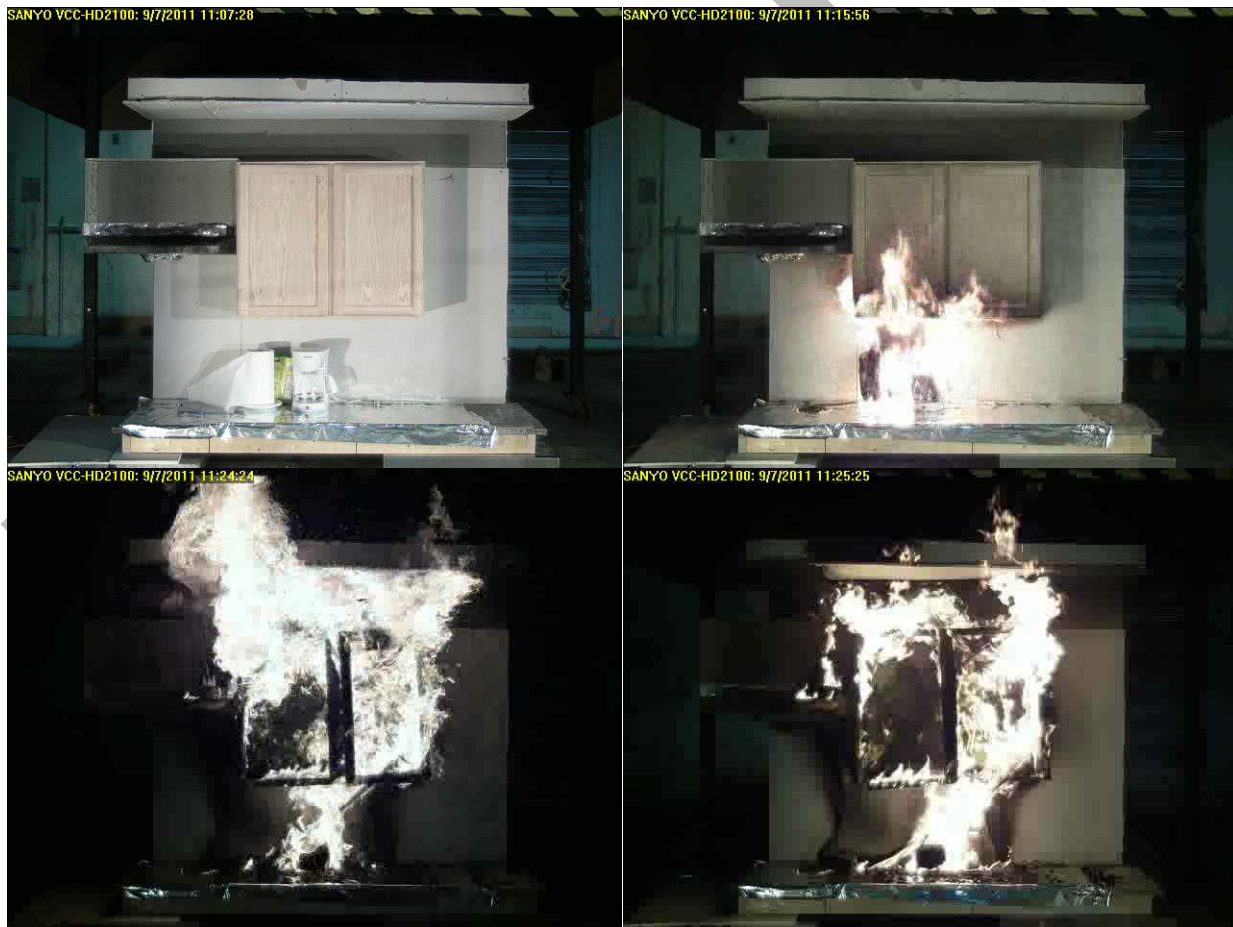


Figure 24. Photo sequence for Test A1 - Oak/pressboard exposed to ignition scenario 1.



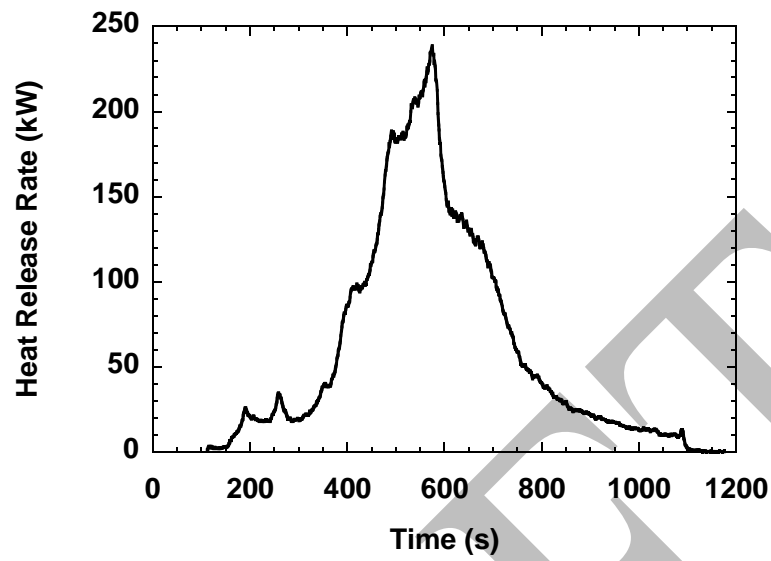


Figure 25. Heat release rate for Test B1 – Laminated pressboard exposed to ignition scenario 1.

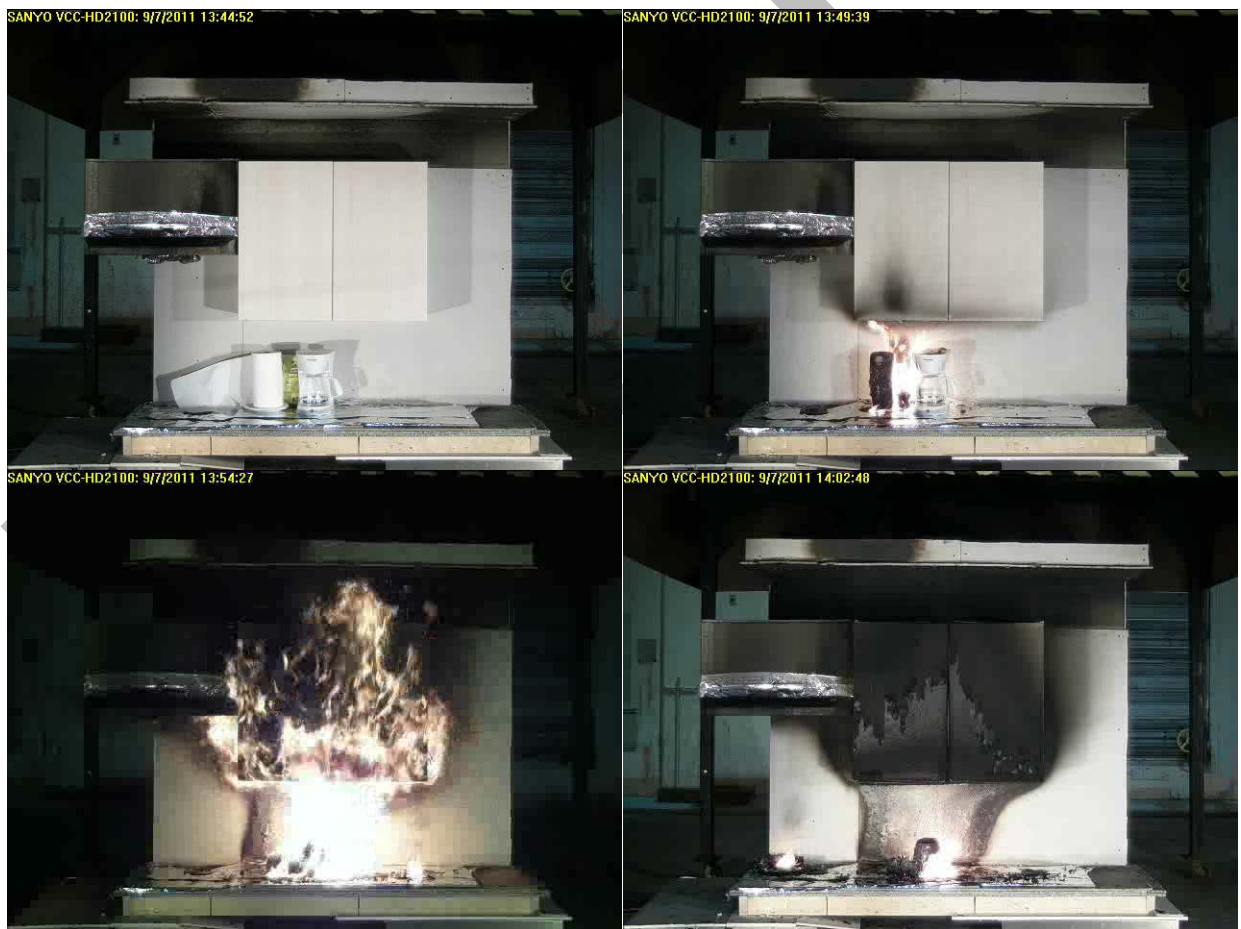


Figure 26. Photo sequence for Test B1 - Laminated pressboard exposed to ignition scenario 1.

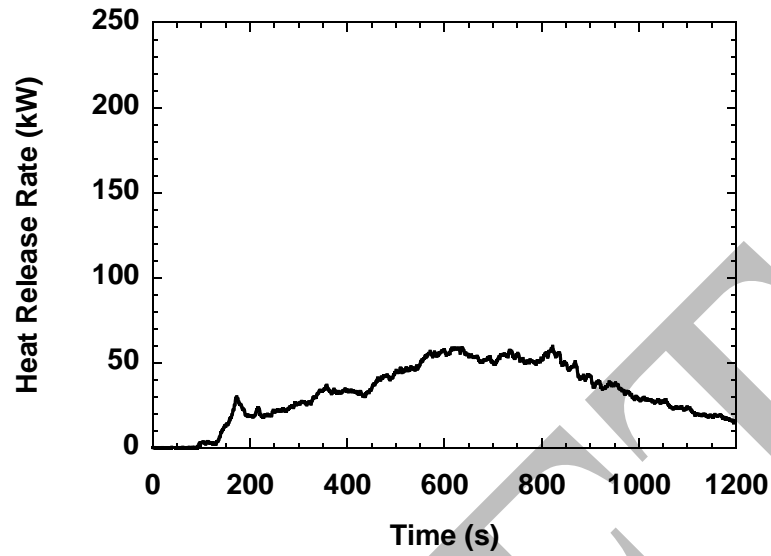


Figure 27. Heat release rate for Test A1B - Oak/pressboard with barrier exposed to ignition scenario 1.



Figure 28. Photo sequence for Test A1B - Oak/pressboard with barrier exposed to ignition scenario

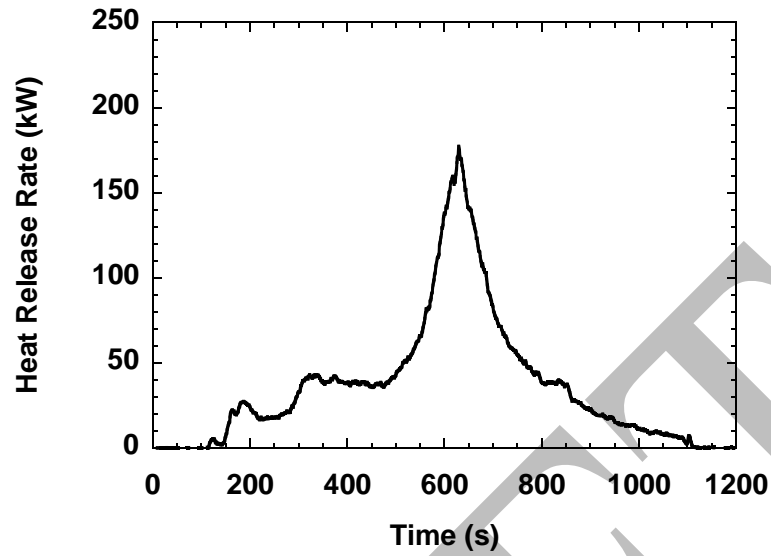


Figure 29. Heat release rate for Test B1B – Lam. pressboard with barrier exposed to ignition scenario 1.

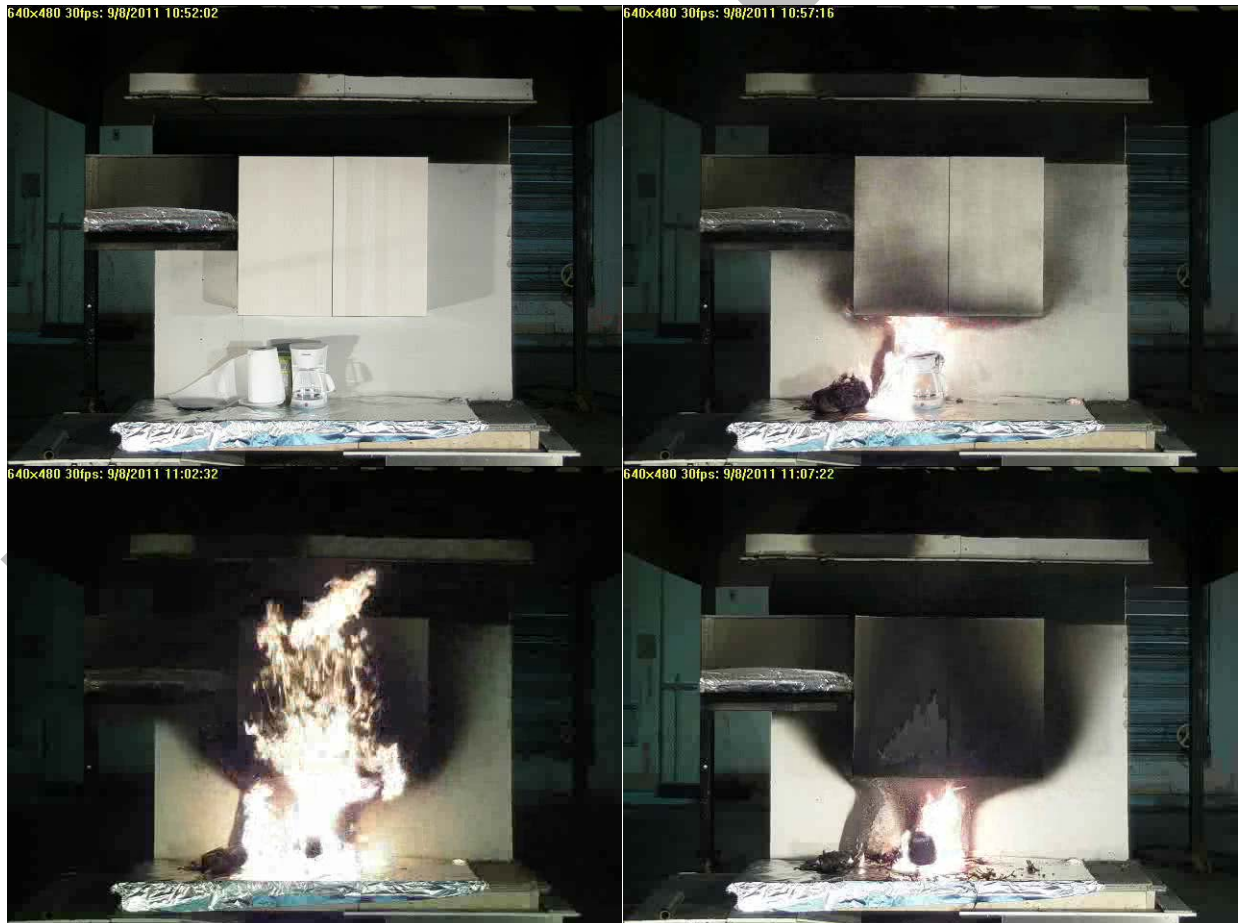


Figure 30. Photo sequence for Test B1B – Lam. pressboard with barrier exposed to ignition scenario 1.

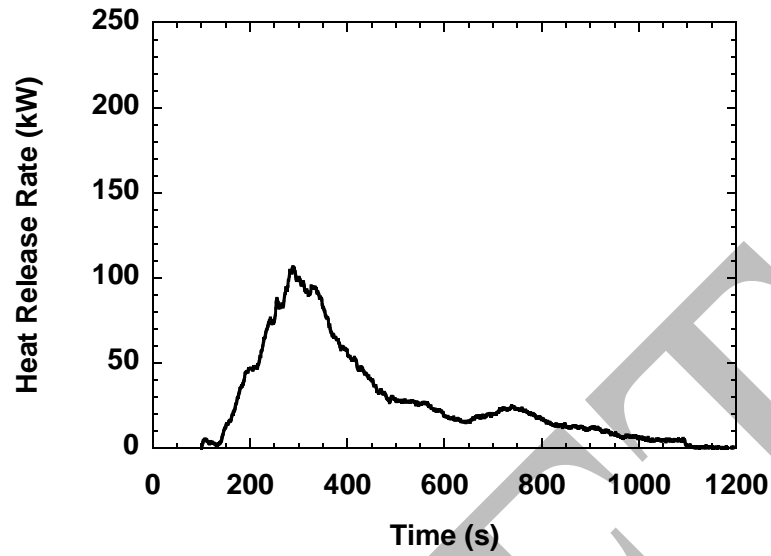


Figure 31. Heat release rate for Test A2 - Oak/pressboard exposed to ignition scenario 2.

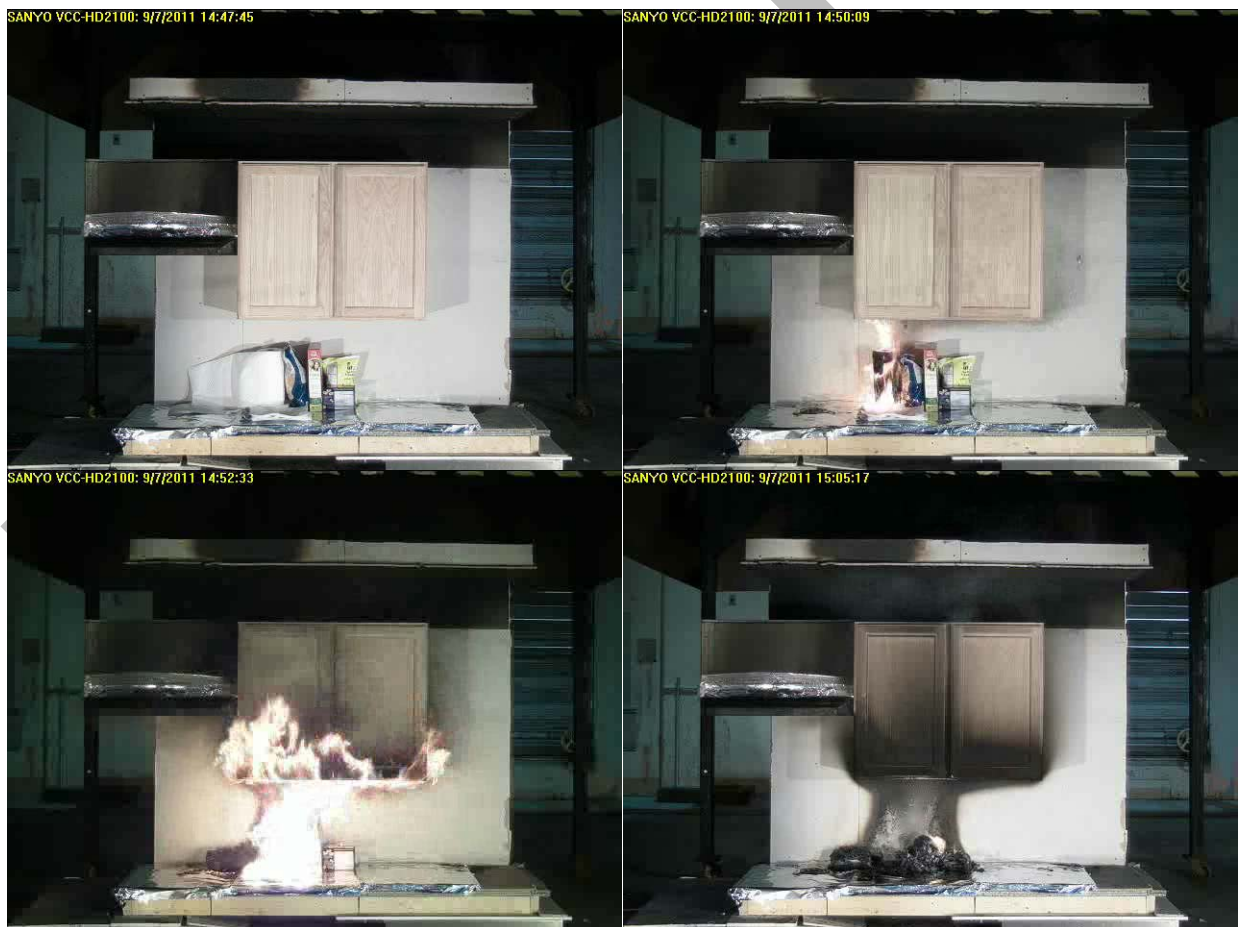


Figure 32. Photo sequence for Test A2 - Oak/pressboard exposed to ignition scenario 2.



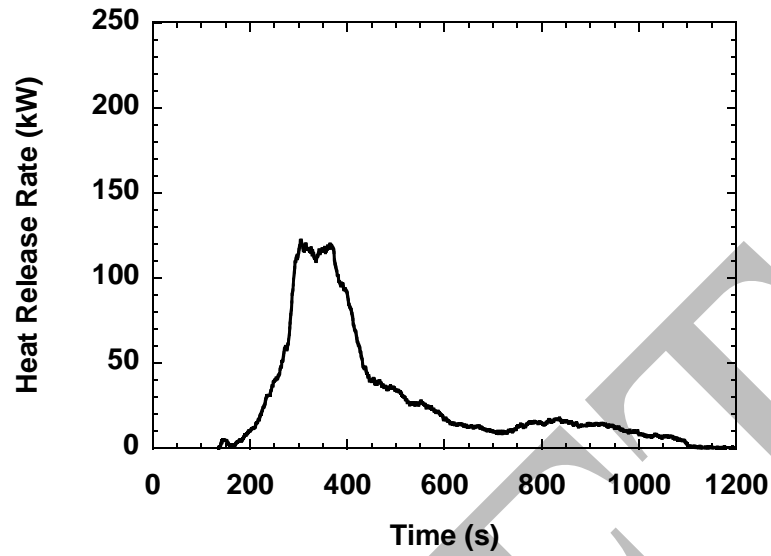


Figure 33. B2 Heat release rate for Test B2 – Laminated pressboard exposed to ignition scenario 2.



Figure 34. Photo sequence for Test B2 - Laminated pressboard exposed to ignition scenario 2.

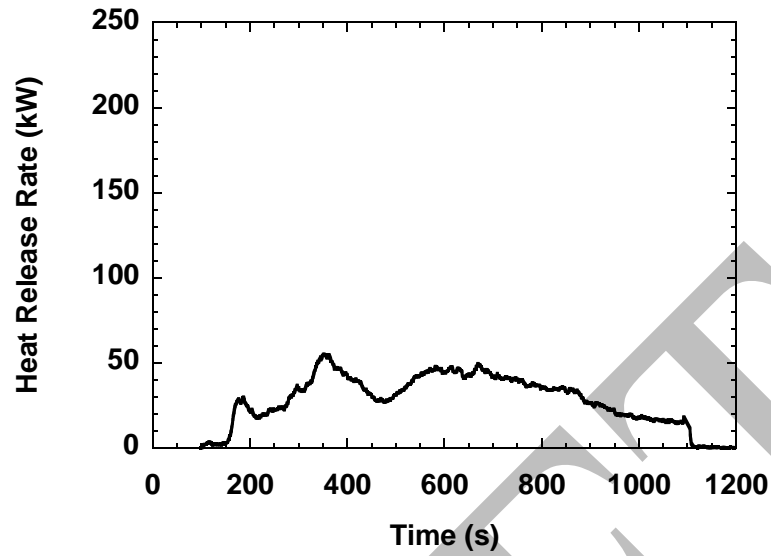


Figure 35. Heat release rate for Test CB1 – Cement board exposed to ignition scenario 1.

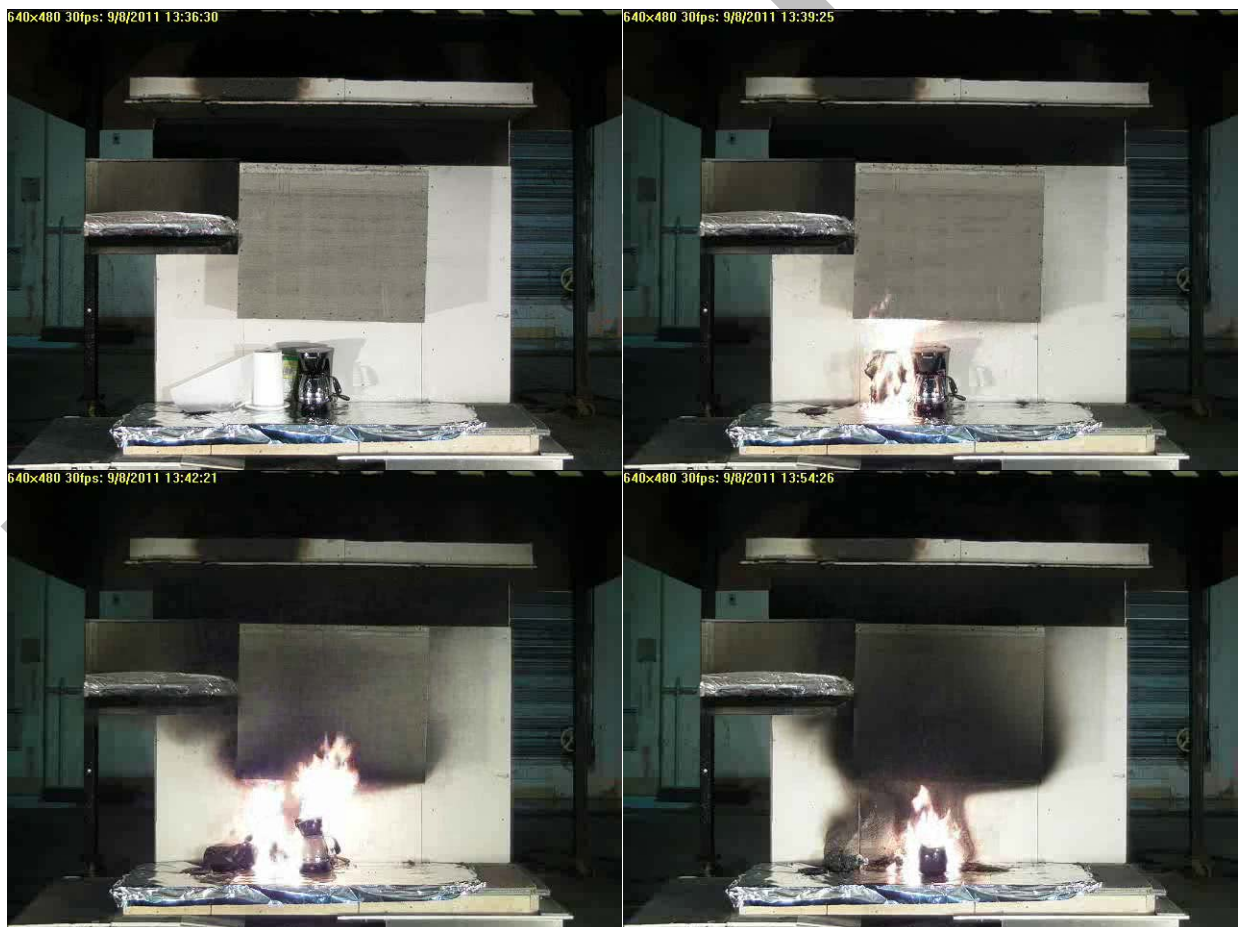


Figure 36. Photo sequence for Test CB1 – Cement board exposed to ignition scenario 1.

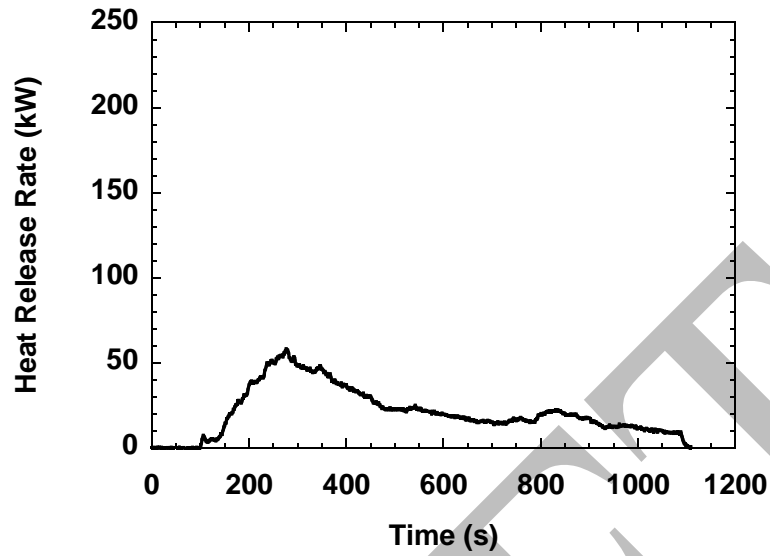


Figure 37. Heat release rate for Test CB2 – Cement board exposed to ignition scenario 2.

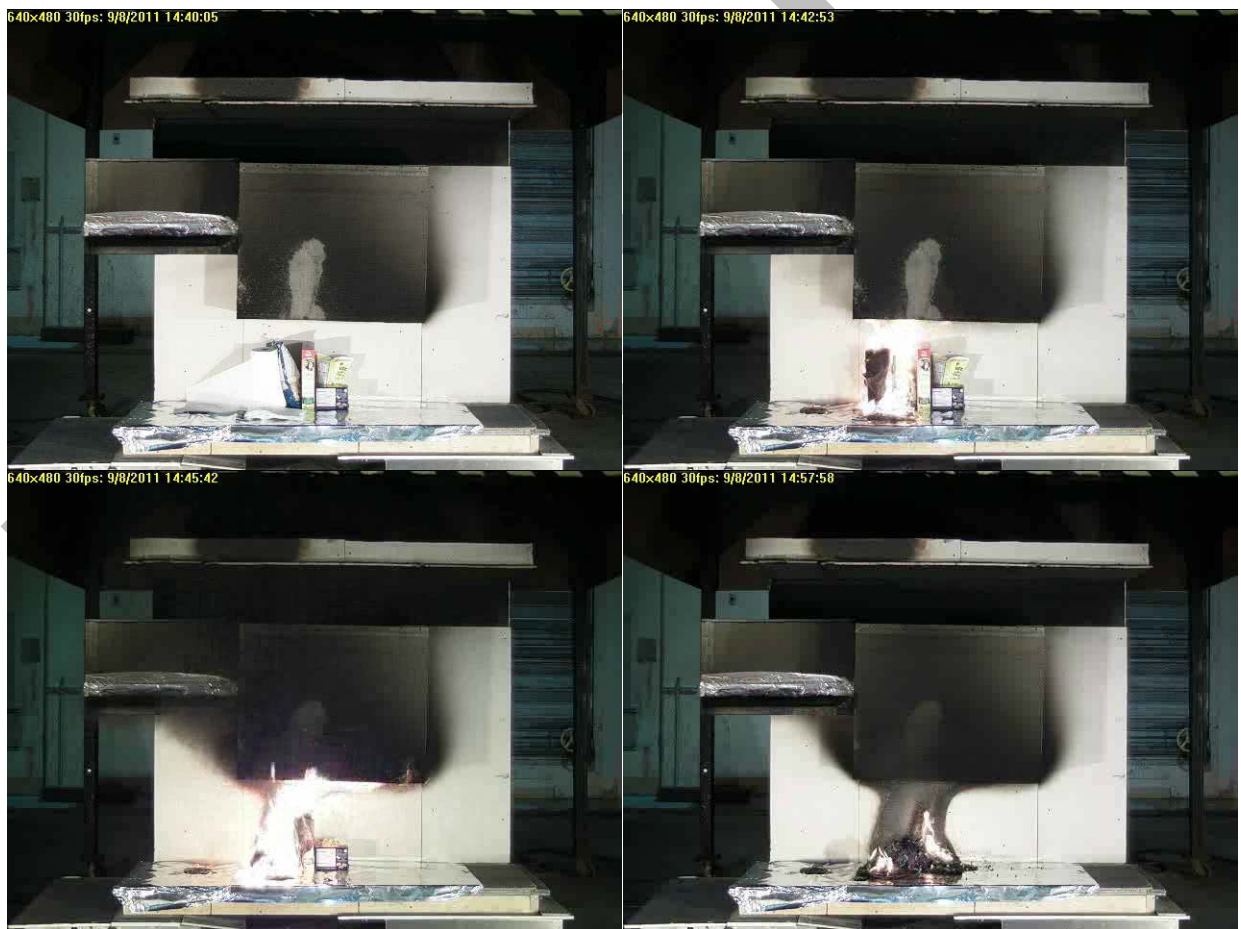


Figure 38. Photo sequence for Test CB2 – Cement board exposed to ignition scenario 2.

### 3.3 Nuisance Alarm Performance

There were eight ceiling locations where up to four smoke alarms could be positioned. Two sets of four alarms were mounted on 16 test boards. Every test board contained a P1 and I1 alarm, and the other two alarms were chosen to spread the various types of alarms across the different test boards. One set of alarms was used for the first three tests for each nuisance scenario, and another set of alarms was used for the next three tests for each nuisance alarm scenario. Figure 39 shows the locations of the smoke alarms. Two sets, Loc 1 and Loc 2, were located inside the kitchen at horizontal distances of 1.82 m and 1.87 m from the spot indicated on the range top. Loc 3 and Loc 4 were located outside different kitchen doorways at horizontal distances from the range top of 2.96 m and 3.33 m, respectively. Loc 5 - 8 were located in the living room at horizontal distances of 4.50 m, 5.39 m, 6.01 m, and 6.94 m, respectively.

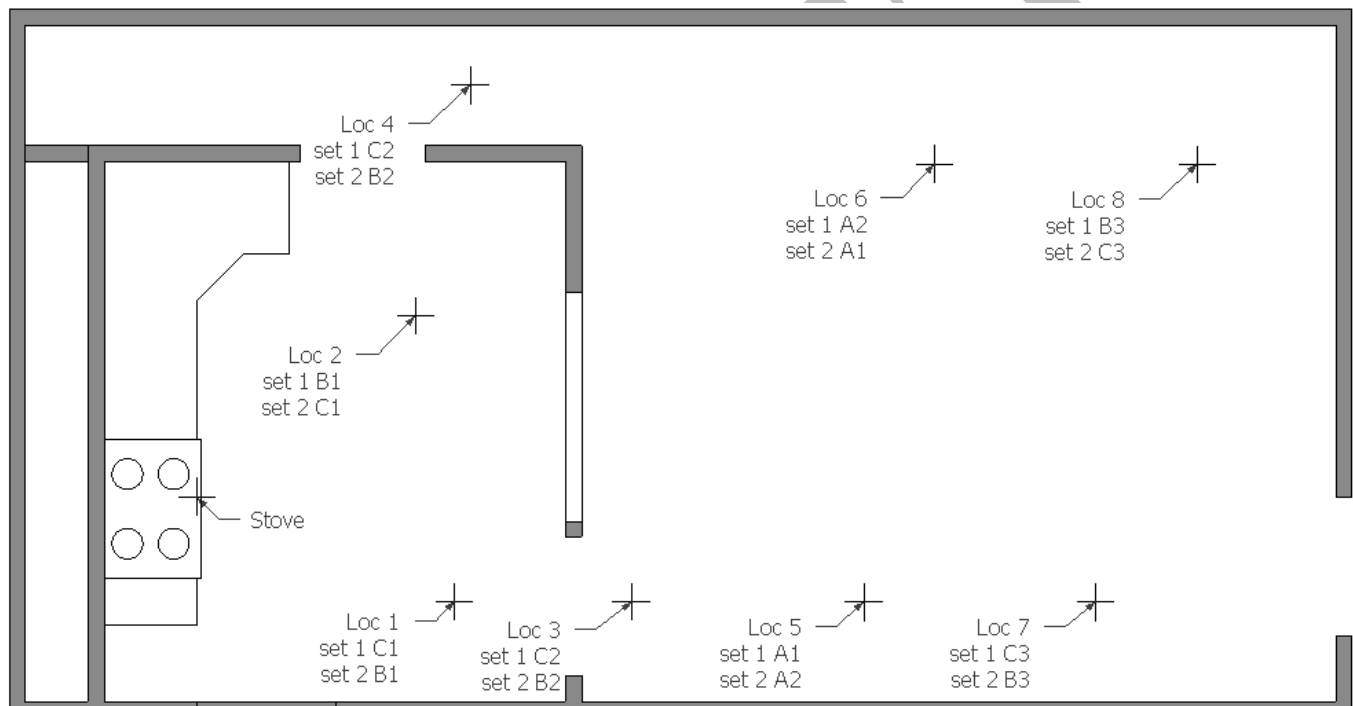


Figure 39. Location of alarms.

Tables 4 - 43 presents the results for the time to alarm for each installed smoke alarm. If the table entry is blank, no alarm was recorded during the test. If the table entry is gray, the particular alarm was not installed during that test.



Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)		375					0.17							NA
1.87 (6.12)	384	384					0.33							NA
2.96 (9.72)		383					0.17							NA
3.33 (10.93)		411					0.17							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 4. Photoelectric alarm activation results – frying bacon.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	270	260	272	258	308	307	1.00							NA
1.87 (6.12)	299	278	314	308	334	334	1.00							NA
2.96 (9.72)	317	303	323	294	307	354	1.00							NA
3.33 (10.93)	384	352	320	368	362		0.83							NA
4.50 (14.77)	391	389	363	347	361		0.83	382	383	339	355	371		0.83
5.39 (17.70)	436	397					0.33	445	396	411	457			0.67
6.01 (19.71)		418					0.33				404	412		0.67
6.94 (22.77)							0.00							0.00

Table 5. Ionization alarm activation results – frying bacon.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				294	315		0.667				259	288	297	1.00
1.87 (6.12)		388					0.333	269	270	274				1.00
2.96 (9.72)				394			0.333				323	337		0.667
3.33 (10.93)		406					0.333	319	330	314				1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00				370	404		0.667
6.94 (22.77)							0.00							0.00

Table 6. Dual sensor alarm activation results – frying bacon.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	357	343	377				1.00	302	290	327				1.00
1.87 (6.12)				314	334	405	1.00							0.00
2.96 (9.72)	380	363					0.67	356	324	364				1.00
3.33 (10.93)							0.00				381			0.33
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 7. Intelligent alarm activation results – frying bacon.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)	246		232	232	236	217	0.83							
1.87 (6.12)	248		240		243	215	0.67							
2.96 (9.72)	274		260			241	0.50							
3.33 (10.93)					257	258	0.33							
4.50 (14.77)						257	0.17						251	0.17
5.39 (17.70)							0.00							0.00
6.01 (19.71)						287	0.17							
6.94 (22.77)							0.00							

Table 8. Photoelectric alarm activation results – grilled cheese sandwich.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)			232	239		234	0.50							
1.87 (6.12)						243	0.17							
2.96 (9.72)							0.00							
3.33 (10.93)							0.00							
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 9. Ionization alarm activation results – grilled cheese sandwich.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)					234	228	0.67				204	231	223	1.00
1.87 (6.12)			255				0.33			239				0.33
2.96 (9.72)						282	0.33						256	0.33
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 10. Dual sensor alarm activation results – grilled cheese sandwich.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)			221				0.33							0.00
1.87 (6.12)				119			0.33							0.00
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)														
5.39 (17.70)														
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 11. Intelligent alarm activation results – grilled cheese sandwich.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)	296	196	279	321	239	300	1.00							NA
1.87 (6.12)	287	314	290	323	331	317	1.00							NA
2.96 (9.72)	293	241	309	341	316	316	1.00							NA
3.33 (10.93)	330	335	332	379	345	359	1.00							NA
4.50 (14.77)	535		408	394		387	0.67	358	427	403	363	338	343	1.00
5.39 (17.70)							0.00	442	472	437	448	463	433	1.00
6.01 (19.71)					543		0.17							NA
6.94 (22.77)	558		586				0.33							NA

Table 12. Photoelectric alarm activation results – frying hamburger.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	271	266	247	196	236	249	1.00							NA
1.87 (6.12)	282	320	285	202	284	324	1.00							NA
2.96 (9.72)	342	357	307	243	261	275	1.00							NA
3.33 (10.93)	318	279	260	360	344	363	1.00							NA
4.50 (14.77)	489	550	404	360	335	344	1.00	480	550	404	365	332	342	1.00
5.39 (17.70)			555	542			0.33	517	564	409	540	581	576	1.00
6.01 (19.71)							0.00				526	526	409	1.00
6.94 (22.77)				544	558	574	1.00							0.00

Table 13. Ionization alarm activation results – frying hamburger.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				315	281	278	1.00				172	191	196	1.00
1.87 (6.12)	315	326	331				1.00	221	210	193				1.00
2.96 (9.72)				337	329	319	1.00				245	300	290	1.00
3.33 (10.93)	377	396	341				1.00	290	330	262				1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00				439	360	368	1.00
6.94 (22.77)							0.00							0.00

Table 14. Dual sensor alarm activation results – frying hamburger.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	638	504	658				1.00	274	299	275				1.00
1.87 (6.12)				281	369	352	1.00				500	502		0.67
2.96 (9.72)			502				0.33	483	503	488				1.00
3.33 (10.93)							0.00				370	462	366	1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 15. Intelligent alarm activation results – frying hamburger.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)	491	448		470		472	0.67							Na
1.87 (6.12)		493	496	464		495	0.67							NA
2.96 (9.72)	479	462	492	493		478	0.83							NA
3.33 (10.93)		508		501		494	0.50							NA
4.50 (14.77)		517		521		515	0.50		499		487		492	0.50
5.39 (17.70)						533	0.17				538		530	0.33
6.01 (19.71)						530	0.17							NA
6.94 (22.77)		601					0.17							NA

Table 16. Photoelectric alarm activation results – stir-frying vegetables.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	412	427	470	413	496	453	1.00							NA
1.87 (6.12)	464	468	478	421		492	0.83							NA
2.96 (9.72)	447	460	467	469	516	474	1.00							NA
3.33 (10.93)	499	478	519	502		526	0.83							NA
4.50 (14.77)	493	495		485		509	0.67	483	507		486		508	0.67
5.39 (17.70)							0.00		554					0.17
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 17. Ionization alarm activation results – stir-frying vegetables.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				420		473	0.66				267	460	446	1.00
1.87 (6.12)		489	499				0.66	429	449	475				1.00
2.96 (9.72)						513	0.33				479	519	475	1.00
3.33 (10.93)		520					0.33	485	470	508				1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00				484		515	0.66
6.94 (22.77)							0.00							0.00

Table 18. Dual sensor alarm activation results – stir-frying vegetables.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	497						0.33	451	437	486				1.00
1.87 (6.12)				459	546	580	1.00							0.00
2.96 (9.72)							0.00		495					0.33
3.33 (10.93)							0.00				506			0.33
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 19. Intelligent alarm activation results – stir-frying vegetables.



Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)	617	615					0.33							NA
1.87 (6.12)	625	616					0.33							NA
2.96 (9.72)	638	640					0.33							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 20. Photoelectric alarm activation results – broiling hamburger.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	549	543	539	534	500	513	1.00							NA
1.87 (6.12)	534	505	507	553	506	576	1.00							NA
2.96 (9.72)	548	539	518	551	532	554	1.00							NA
3.33 (10.93)	554	531	496	606	573	613	1.00							NA
4.50 (14.77)	581	588	566	629	583	711	1.00	579	560	536	619	569	561	1.00
5.39 (17.70)	652	645	674	852	770	875	1.00	610	617	621	660	655	734	1.00
6.01 (19.71)	716	651	646				1.00				640	617	650	1.00
6.94 (22.77)				679	669	705	1.00	790	668	727				1.00

Table 21. Ionization alarm activation results – broiling hamburger.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				613	584	700	1.00				466	463	442	1.00
1.87 (6.12)	869	757					0.67	522	515	508				1.00
2.96 (9.72)				801			0.33				583	574	580	1.00
3.33 (10.93)	626	613	631				1.00	522	501	595				1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00				590	560	606	1.00
6.94 (22.77)							0.00	646	631	653				1.00

Table 22. Dual sensor alarm activation results – broiling hamburger.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	558	501	741				1.00	574	579	581				1.00
1.87 (6.12)				506	525	360	1.00					841		0.33
2.96 (9.72)	811	795	918				1.00	757	621					0.67
3.33 (10.93)				725	951	950	1.00				810	673	812	1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)	553	922	879				1.00	868	881					0.67
6.94 (22.77)							0.00							0.00

Table 23. Intelligent alarm activation results – broiling hamburger.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)							0.00							NA
1.87 (6.12)							0.00							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 24. Photoelectric alarm activation results – baking pizza.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)				8	632	609	0.50							NA
1.87 (6.12)	608	608	9	7	16		0.83							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 25. Ionization alarm activation results – baking pizza.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)							0.00				10	11	12	1.00
1.87 (6.12)							0.00			12				0.33
2.96 (9.72)							0.00				25			0.33
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00				631			0.33
6.94 (22.77)							0.00							0.00

Table 26. Dual sensor alarm activation results – baking pizza.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	265	4	264				1.00							0.00
1.87 (6.12)				39	456	500	1.00							0.00
2.96 (9.72)	262	287	545				1.00							0.00
3.33 (10.93)				176			0.33							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)	448	434	458				1.00							0.00
6.94 (22.77)							0.00							0.00

Table 27. Intelligent alarm activation results – baking pizza.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)							0.00							NA
1.87 (6.12)							0.00							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 28. Photoelectric alarm activation results – light toast.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)							0.00							NA
1.87 (6.12)	113						0.17							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 29. Ionization alarm activation results – light toast.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)							0.00							0.00
1.87 (6.12)							0.00							0.00
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 30. Dual sensor alarm activation results – light toast.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)							0.00							0.00
1.87 (6.12)							0.00							0.00
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 31. Intelligent alarm activation results – light toast.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)							0.00							NA
1.87 (6.12)							0.00							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 32. Photoelectric alarm activation results – dark toast.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	164	161	155	192	171	167	1.00							NA
1.87 (6.12)	116	121	129	147	137	156	1.00							NA
2.96 (9.72)	221	237	215	232	204	209	1.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 33. Ionization alarm activation results – dark toast.



Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)					183	185	0.67				157	174	171	1.00
1.87 (6.12)	173	191	192				1.00	173	191	192				1.00
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 34. Dual sensor alarm activation results – dark toast.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	226						0.33	190	196	179				1.00
1.87 (6.12)					179	169	0.67				177	186	185	1.00
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 35. Intelligent alarm activation results – dark toast.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)	359	352	349	368	349	346	1.00							NA
1.87 (6.12)	332	336	323	333	328	346	1.00							NA
2.96 (9.72)	366	356	351	370	367	381	1.00							NA
3.33 (10.93)	388	414	384	446	438	419	1.00							NA
4.50 (14.77)	411	497	396	427	517	565	1.00	412	430	389	409	423	414	1.00
5.39 (17.70)	489		465				0.33	481		446				0.33
6.01 (19.71)					594		0.17							NA
6.94 (22.77)							0.00							NA

Table 36. Photoelectric alarm activation results – very dark toast.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	182	188	194	196	183	187	1.00							NA
1.87 (6.12)	152	150	160	165	161	155	1.00							NA
2.96 (9.72)	231	209	214	216	216	241	1.00							NA
3.33 (10.93)	439	347	375	257	298	295	1.00							NA
4.50 (14.77)	316	272	320	361	314	341	1.00	315	281	334	323	314	341	1.00
5.39 (17.70)				424	424		0.33				474			0.17
6.01 (19.71)			332				0.33					624		0.33
6.94 (22.77)							0.00							0.00

Table 37. Ionization alarm activation results – very dark toast.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				227	218	237	1.00				189	184	173	1.00
1.87 (6.12)	196	206	206				1.00	180	173	177				1.00
2.96 (9.72)				267	266	303	1.00				269	245	235	1.00
3.33 (10.93)	418	385	397				1.00	292	250	263				1.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)						624	0.33					397	372	0.67
6.94 (22.77)							0.00							0.00

Table 38. Dual sensor alarm activation results – very dark toast.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)	248	236	253				1.00	211	200	194				1.00
1.87 (6.12)				202	191	205	1.00				201	210	204	1.00
2.96 (9.72)	288	268	294				1.00	366	356	351				1.00
3.33 (10.93)				317	382		0.67				329	344	363	1.00
4.50 (14.77)														
5.39 (17.70)														
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 39. Intelligent alarm activation results – very dark toast.

Distance from Stove, m (ft)	P1 Exp. 1 T <sub>A</sub> (s)	P1 Exp. 2 T <sub>A</sub> (s)	P1 Exp. 3 T <sub>A</sub> (s)	P1 Exp. 4 T <sub>A</sub> (s)	P1 Exp. 5 T <sub>A</sub> (s)	P1 Exp. 6 T <sub>A</sub> (s)	P1 Alarm Freq.	P2 Exp. 1 T <sub>A</sub> (s)	P2 Exp. 2 T <sub>A</sub> (s)	P2 Exp. 3 T <sub>A</sub> (s)	P2 Exp. 4 T <sub>A</sub> (s)	P2 Exp. 5 T <sub>A</sub> (s)	P2 Exp. 6 T <sub>A</sub> (s)	P2 Alarm Freq.
1.82 (5.98)							0.00							NA
1.87 (6.12)							0.00							NA
2.96 (9.72)							0.00							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							NA
6.94 (22.77)							0.00							NA

Table 40. Photoelectric alarm activation results – toasting bagel.

Distance from Stove, m (ft)	I1 Exp. 1 T <sub>A</sub> (s)	I1 Exp. 2 T <sub>A</sub> (s)	I1 Exp. 3 T <sub>A</sub> (s)	I1 Exp. 4 T <sub>A</sub> (s)	I1 Exp. 5 T <sub>A</sub> (s)	I1 Exp. 6 T <sub>A</sub> (s)	I1 Alarm Freq.	I2 Exp. 1 T <sub>A</sub> (s)	I2 Exp. 2 T <sub>A</sub> (s)	I2 Exp. 3 T <sub>A</sub> (s)	I2 Exp. 4 T <sub>A</sub> (s)	I2 Exp. 5 T <sub>A</sub> (s)	I2 Exp. 6 T <sub>A</sub> (s)	I2 Alarm Freq.
1.82 (5.98)	197	201	160	192	178	186	1.00							NA
1.87 (6.12)	149	153	138	178	155	160	1.00							NA
2.96 (9.72)		237	233			229	0.50							NA
3.33 (10.93)							0.00							NA
4.50 (14.77)							0.00							0.00
5.39 (17.70)							0.00							0.00
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 41. Ionization alarm activation results – toasting bagel.

Distance from Stove, m (ft)	D1 Exp. 1 T <sub>A</sub> (s)	D1 Exp. 2 T <sub>A</sub> (s)	D1 Exp. 3 T <sub>A</sub> (s)	D1 Exp. 4 T <sub>A</sub> (s)	D1 Exp. 5 T <sub>A</sub> (s)	D1 Exp. 6 T <sub>A</sub> (s)	D1 Alarm Freq.	D2 Exp. 1 T <sub>A</sub> (s)	D2 Exp. 2 T <sub>A</sub> (s)	D2 Exp. 3 T <sub>A</sub> (s)	D2 Exp. 4 T <sub>A</sub> (s)	D2 Exp. 5 T <sub>A</sub> (s)	D2 Exp. 6 T <sub>A</sub> (s)	D2 Alarm Freq.
1.82 (5.98)				226		194	0.67				182	193	184	1.00
1.87 (6.12)		218	213				0.67	171	173	160				1.00
2.96 (9.72)							0.00				256	240	230	1.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 42. Dual sensor alarm activation results – toasting bagel.

Distance from Stove, m (ft)	M1 Exp. 1 T <sub>A</sub> (s)	M1 Exp. 2 T <sub>A</sub> (s)	M1 Exp. 3 T <sub>A</sub> (s)	M1 Exp. 4 T <sub>A</sub> (s)	M1 Exp. 5 T <sub>A</sub> (s)	M1 Exp. 6 T <sub>A</sub> (s)	M1 Alarm Freq.	M2 Exp. 1 T <sub>A</sub> (s)	M2 Exp. 2 T <sub>A</sub> (s)	M2 Exp. 3 T <sub>A</sub> (s)	M2 Exp. 4 T <sub>A</sub> (s)	M2 Exp. 5 T <sub>A</sub> (s)	M2 Exp. 6 T <sub>A</sub> (s)	M2 Alarm Freq.
1.82 (5.98)							0.00	214		219				0.67
1.87 (6.12)							0.00					212	206	0.67
2.96 (9.72)							0.00							0.00
3.33 (10.93)							0.00							0.00
4.50 (14.77)							NA							NA
5.39 (17.70)							NA							NA
6.01 (19.71)							0.00							0.00
6.94 (22.77)							0.00							0.00

Table 43. Intelligent alarm activation results – toasting bagel.

The propensity of an alarm to activate appears to be a function of the type of alarm, its sensitivity, its distance from the cooking activity, and the cooking event itself. For example, only one ionization alarm activated during the six light toasting experiments, while most alarms within 4.5 m of the range activated during the six very dark toast experiments. In order to analyze alarm activation propensities, the results from similar cooking activities were aggregated, as were the results for alarm location pairs 1-2, 3-4, 5-6, and 7-8. Results from cooking activities that employed the electric range, oven, or toaster were aggregated for individual alarms and alarm locations. The distances from the cooking source to the alarm location pairs were averaged to present the results as a function of distance.

Figure 40 shows the fraction of specific types of alarms activated during the aggregated range top cooking events as a function of distance. In general, the fraction of activated alarms decreased as the distance from the cooking source increased, as expected. D2 appears to be the most sensitive to nuisance alarm during the range top cooking activities, while D1, M1, and M2 all had no activations at the farthest distance from the cooking source.

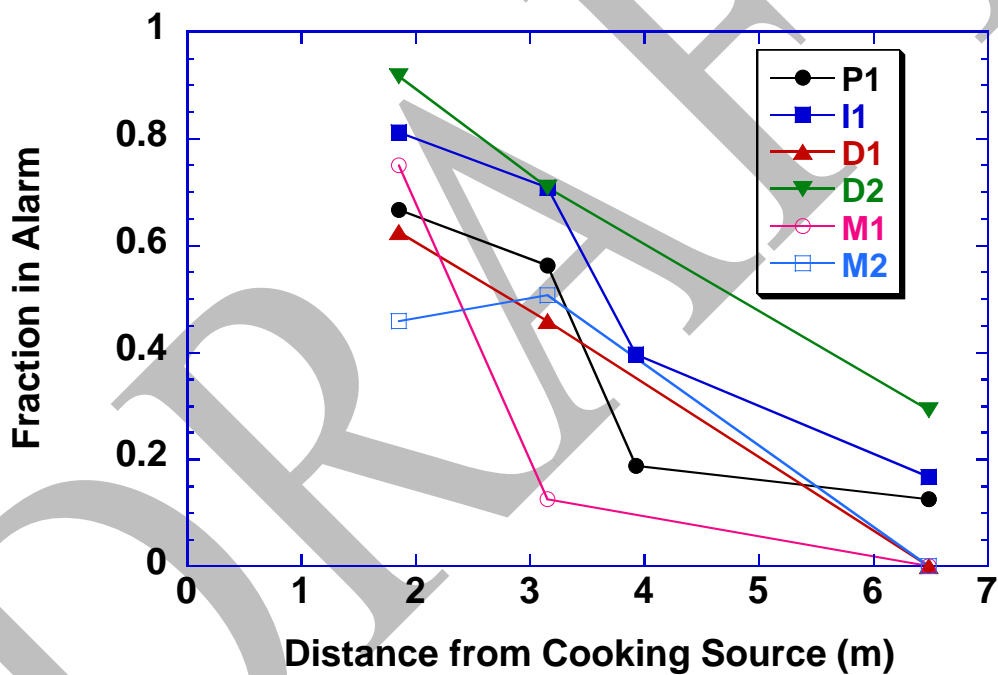


Figure 40. Fraction of smoke alarms that activated during range top cooking events.

Figure 41 shows the fraction of specific types of alarms activated during the aggregated electric oven events as a function of distance. M1 alarms activated during the oven cooking events whenever one was located in the kitchen, but none activated when located at the furthest two locations in the living room. The fraction of I1 and D2 alarms activated dropped when the alarms were located outside the kitchen, but the fraction in alarm was the same for the other aggregated distances. P1 alarms activated less than 20 percent of the time they were present in the kitchen and recorded no alarm activations beyond 3.2 m from the range top.

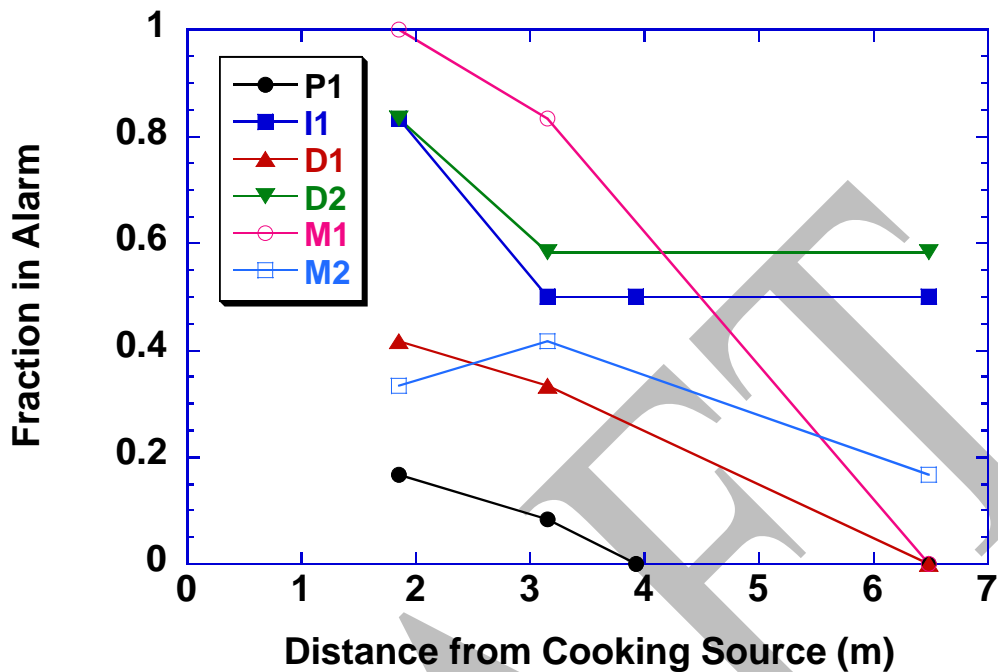


Figure 41. Fraction of smoke alarms that activated during oven cooking events.

Figure 42 shows the fraction of specific types of alarms activated during the aggregated toasting events as a function of distance. I1 and D2 activated more than 75 percent of the time they were present in the kitchen, while P1 activated approximately 25 percent of the time. The fraction of alarm activations dropped as the distance from the cooking source increased for all alarm types.

The propensity of nuisance alarms in actual usage depends on the frequency of the exposure events. It is still illustrative to present an averaged nuisance alarm response to cooking events. Instead of aggregating all cooking events, the fraction of alarms activated for the aggregated cooking activities, electric range, oven, and toasting were averaged so that each activity represented one third of all events. Figure 43 shows the alarm activation frequency for the three averaged cooking activities. Inside the kitchen, P1 has the lowest activation frequency, while I1 and D2 are both above 80 percent. The alarm activation frequency drops as the distance from the range top increases. I1 and D2 exhibit higher activation frequencies than the other four alarms P1, D1, M1, and M2. Outside the kitchen, those four alarm activation frequency values are similar at the different distances. These observations strengthen the case to keep smoke alarms outside of kitchens, if possible, and if necessary due to overriding installation requirements in other parts of the code, consider photoelectric type alarms near or within the kitchen. Outside the kitchen, the nuisance alarm performance of P1, D1, M1, and M2 is similar; they all appear significantly better than I1 and D2.



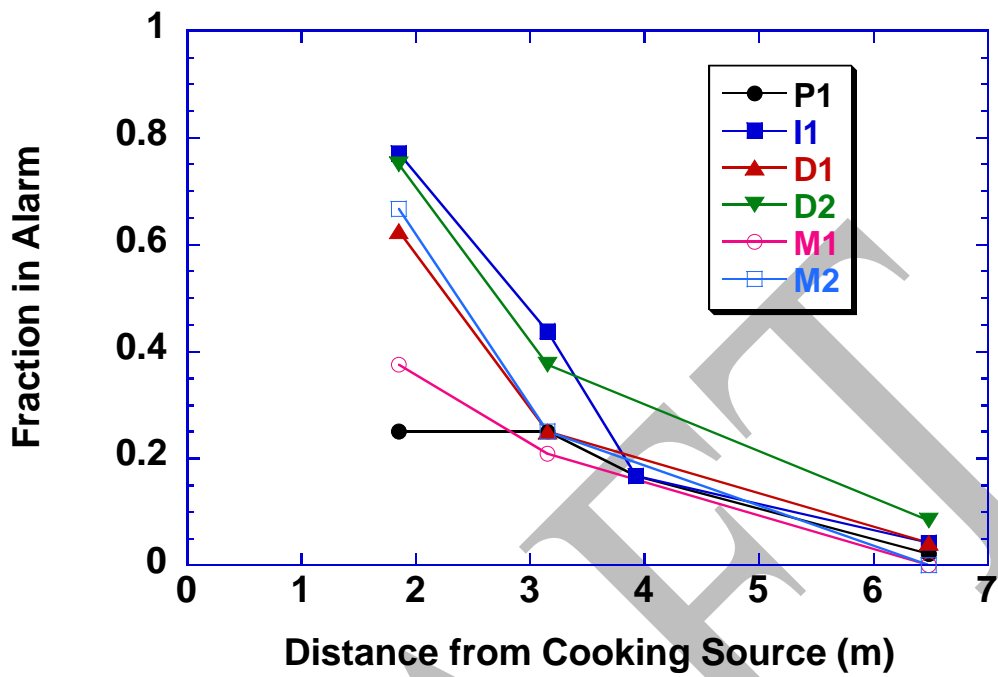


Figure 42. Fraction of smoke alarms that activated during toasting events.

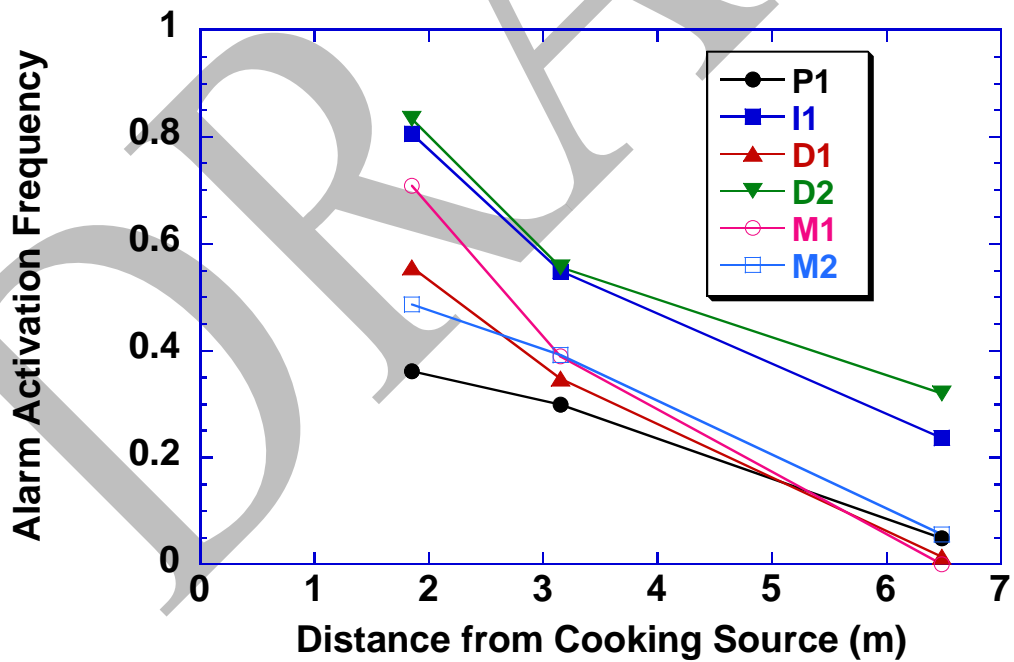


Figure 43. Alarm activation frequency for equal fractions of range top, oven, and toasting activities.

### 3.4 Kitchen Fire Alarm Performance

A total of 10 fire tests were conducted, Table 44 identifies the configurations.

Test Name	Cabinet Construction	Ignition Scenario
A1_1	Oak/Pressboard	1
A1_2	Oak/Pressboard	1
A2_1	Oak/Pressboard	2
A2_2	Oak/Pressboard	2
B1_1	Laminated Pressboard	1
B1_2	Laminated Pressboard	1
B2_1	Laminated Pressboard	2
B2_2	Laminated Pressboard	2
A3_1	Oak/Pressboard, Sheet Metal Barrier	1
B3_1	Laminated Pressboard, Sheet Metal Barrier	1

Table 44. Configurations for kitchen fire tests.

For each test, up to 10 unused smoke alarms were installed on the ceiling at the various locations. The locations of the different types of smoke alarms were varied from test to test. However, only photoelectric alarms were placed at locations Loc 1 and Loc 2 inside the kitchen, to limit the potential for thermal damage of the ionization sensors in the other alarms.

The time to alarm was recorded for every smoke alarm installed in each test. The tenability conditions were assessed in the hallway and the living room to determine if any given installed alarm provided sufficient time for egress. The tenability was assessed by considering the smoke optical density (OD) and the fractional effective dose (FED) of toxic gases or convected heat. The FED is a non-dimensional, time-integrated value of the exposure effects to toxic gases or convected and radiated heat that would be experienced by an occupant. The fractional effective dose (FED) calculation schemes are described in the standard ISO/FDIS 1375 (15). A FED of 1.0 is associated with 50 percent of exposed persons experiencing incapacitation and unable to effect escape. While the ISO standard does not include a FED incapacitation distribution, a FED value of 0.3 has been promoted as an exposure level that ensures that most occupants would not become incapacitated. CO and CO<sub>2</sub> gas concentrations, and air temperature measurements at a height 1.5 m from the floor were used to calculate the toxic gas and convected heat FEDs.

Results for each test are presented in the tables (Tables 45–54) and figures (Figures 44–71) that follow. Each table documents the time to alarm and the location for each alarm installed for a particular experiment. If the table entry is blank, no alarm was recorded during the test. If the table entry is gray, the particular alarm was not installed during that test. Next, a sequence of four images shows the fire progression at 0, 120 s, 240 s, and 360 s after ignition, followed by an end-of-test picture of the cabinet for most tests. Lastly, the smoke optical density and the heat and toxic gases fractional effective dose (gases and temperature) for each measurement location are presented. The Y axis is scaled to the smoke optical density in m<sup>-1</sup> and the toxic gas and heat FED, which are dimensionless.

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)	241	153						
1.87 (6.12)								
2.96 (9.72)	243		162				184	
3.33 (10.93)	241		214		238			
4.50 (14.77)			209					236
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)								

Table 45. Alarm times for experiment A1\_1 (Oak/pressboard, scenario 1).

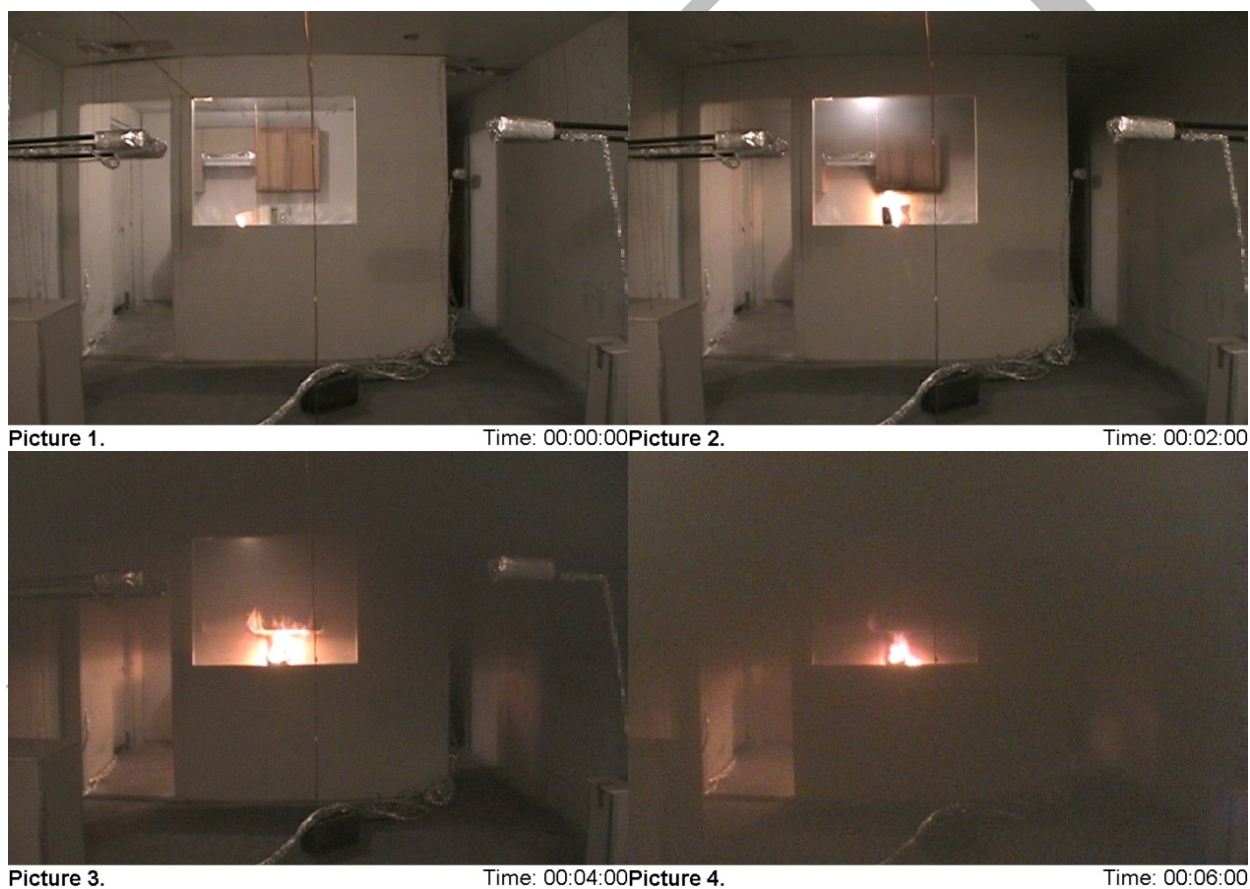


Figure 44. Photo sequence for experiment A1\_1 (Oak/pressboard, scenario 1).



Figure 45. Post-fire photo of experiment A1\_1 (Oak/pressboard, scenario 1).

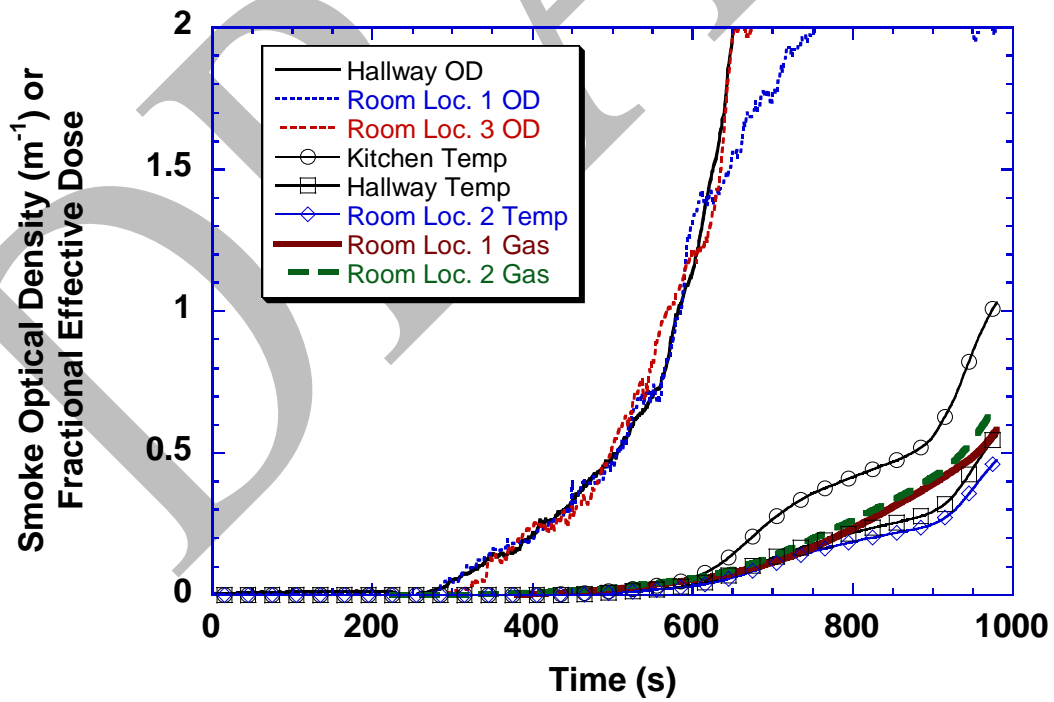


Figure 46. OD and FED values for experiment A1\_1 (Oak/pressboard, scenario 1).



Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)								
1.87 (6.12)	117	121						
2.96 (9.72)		133		127		129		
3.33 (10.93)								
4.50 (14.77)								
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)	247		222				248	

Table 46. Alarm times for Experiment A1\_2 (Oak/pressboard, scenario 1).



Figure 47. Photo sequence for experiment A1\_2 (Oak/pressboard, scenario 1).

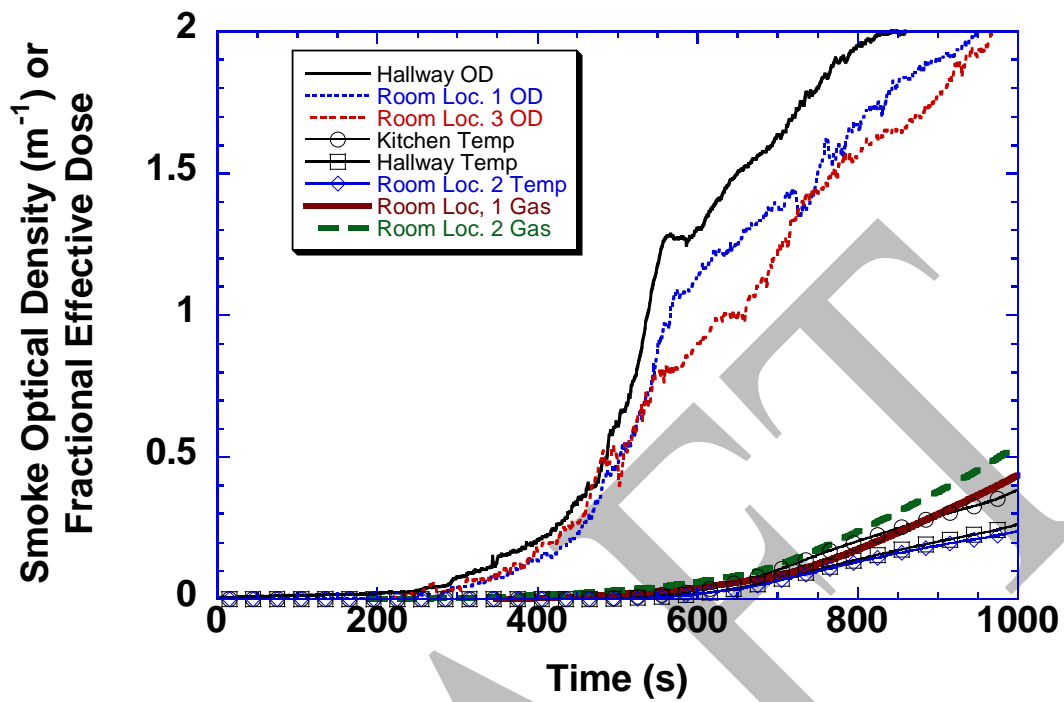


Figure 48. OD and FED values for experiment A1\_2 (Oak/pressboard, scenario 1).

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)	104	98						
1.87 (6.12)								
2.96 (9.72)	115		115				122	
3.33 (10.93)								
4.50 (14.77)								
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)		190		178		159		

Table 47. Alarm times for Experiment A2\_1 (Oak/pressboard, scenario 2).



Figure 49. Photo sequence for experiment A2\_1 (Oak/pressboard, scenario 2).



Figure 50. Post-fire photo of experiment A2\_1 (Oak/pressboard, scenario 2).

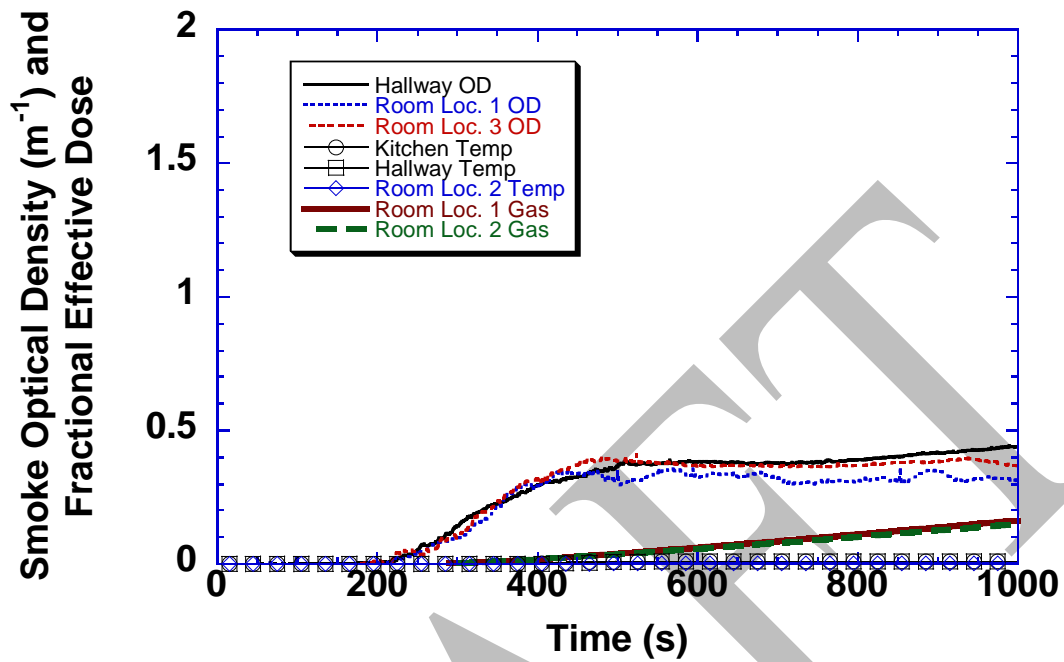


Figure 51. OD and FED values for experiment A2\_1 (Oak/pressboard, scenario 2).

Distance from Stove, m (ft)	P1 $T_a$ (s)	P2 $T_a$ (s)	I1 $T_a$ (s)	I2 $T_a$ (s)	D1 $T_a$ (s)	D2 $T_a$ (s)	M1 $T_a$ (s)	M2 $T_a$ (s)
1.82 (5.98)	125	119						
1.87 (6.12)								
2.96 (9.72)								
3.33 (10.93)	205		154		181			
4.50 (14.77)			159					169
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)								

Table 48. Alarm times for experiment A2\_2 (Oak/pressboard, scenario 2).





Figure 52. Photo sequence for experiment A2\_2 (Oak/pressboard, scenario 2).



Figure 53. Post-fire photo of experiment A2\_2 (Oak/pressboard, scenario 2).

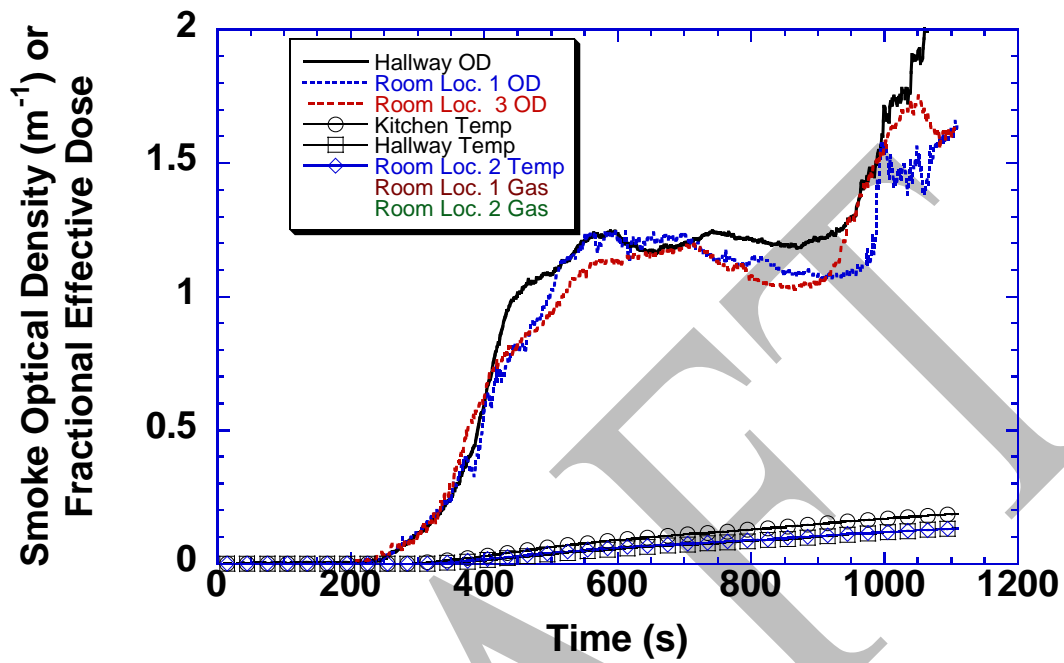


Figure 54. OD and FED values for experiment A2\_2 (Oak/pressboard, scenario 2).

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)	173	167						
1.87 (6.12)								
2.96 (9.72)			123			128	140	
3.33 (10.93)	182		142		180			
4.50 (14.77)			145					168
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)								

Table 49. Alarm times for Experiment B1\_1 (Laminated pressboard, scenario 1).





Figure 55. Photo sequence for experiment B1\_1 (Laminated pressboard, scenario 1).



Figure 56. Post-fire photo of experiment B1\_1 (Laminated pressboard, scenario 1).

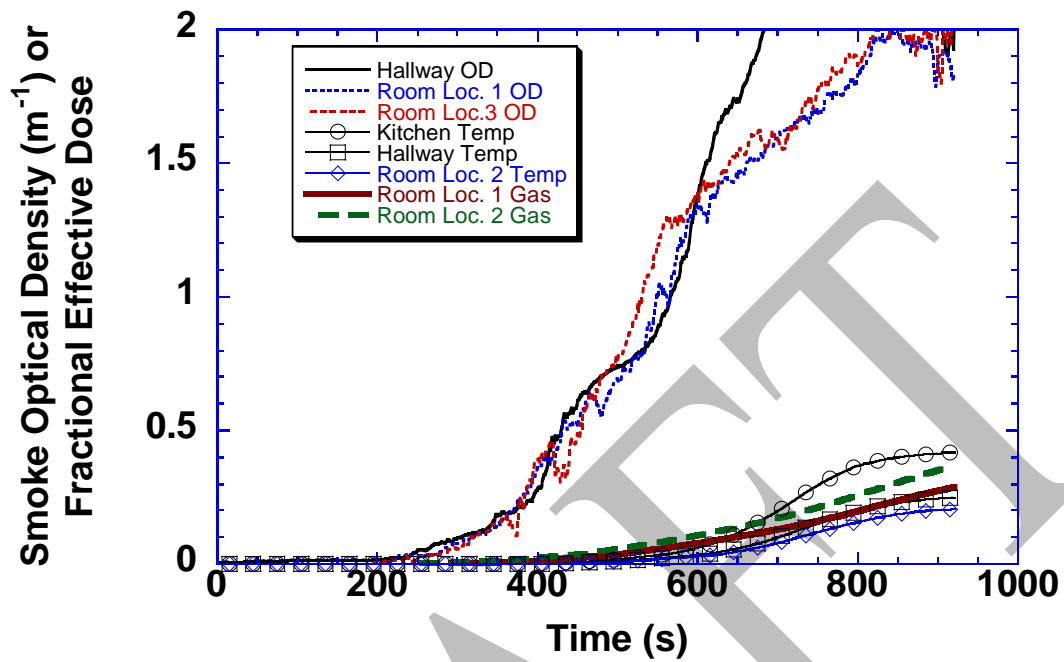


Figure 57. OD and FED values for experiment B1\_1 (Laminated pressboard, scenario 1).

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)								
1.87 (6.12)	113	140						
2.96 (9.72)	121		117				128	
3.33 (10.93)								
4.50 (14.77)								
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)	193			163		156		

Table 50. Alarm times for Experiment B1\_2 (Laminated pressboard, scenario 1).



Figure 58. Photo sequence for experiment B1\_2 (Laminated pressboard, scenario 1).



Figure 59. Post-fire photo of experiment B1\_2 (Laminated pressboard, scenario 1).



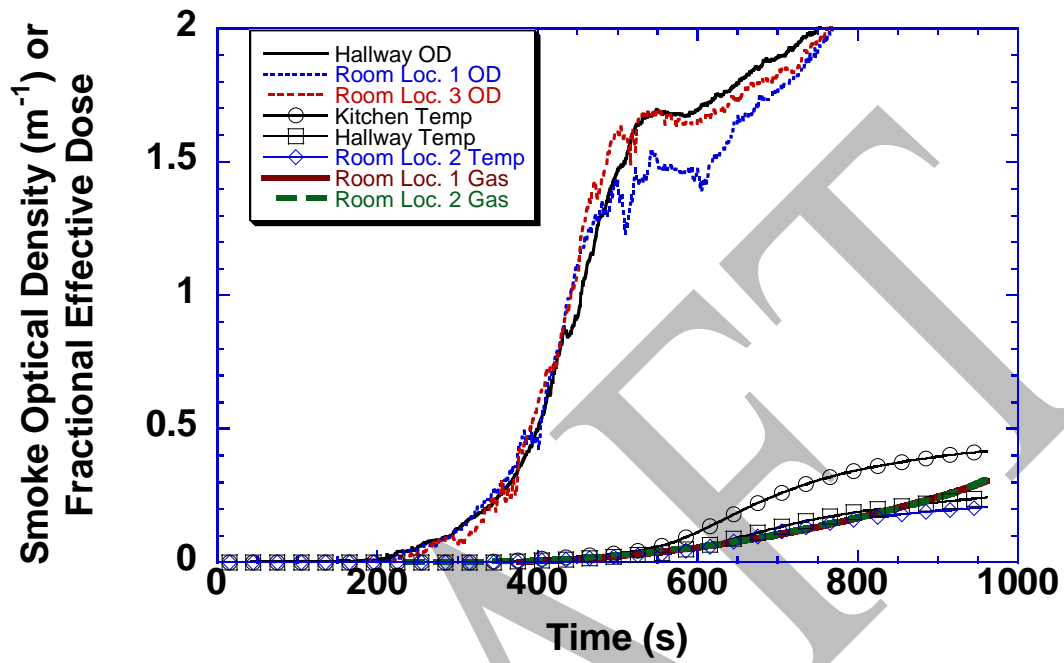


Figure 60. OD and FED values for experiment B1\_2 (Laminated pressboard, scenario 1)

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)	126	127						
1.87 (6.12)								
2.96 (9.72)		140		137		134		
3.33 (10.93)			150					170
4.50 (14.77)								
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)	232		193				211	

Table 51. Alarm times for Experiment B2\_1 (Laminated pressboard, scenario 2).



Figure 61. Photo sequence for experiment B2\_1 (Laminated pressboard, scenario 2).

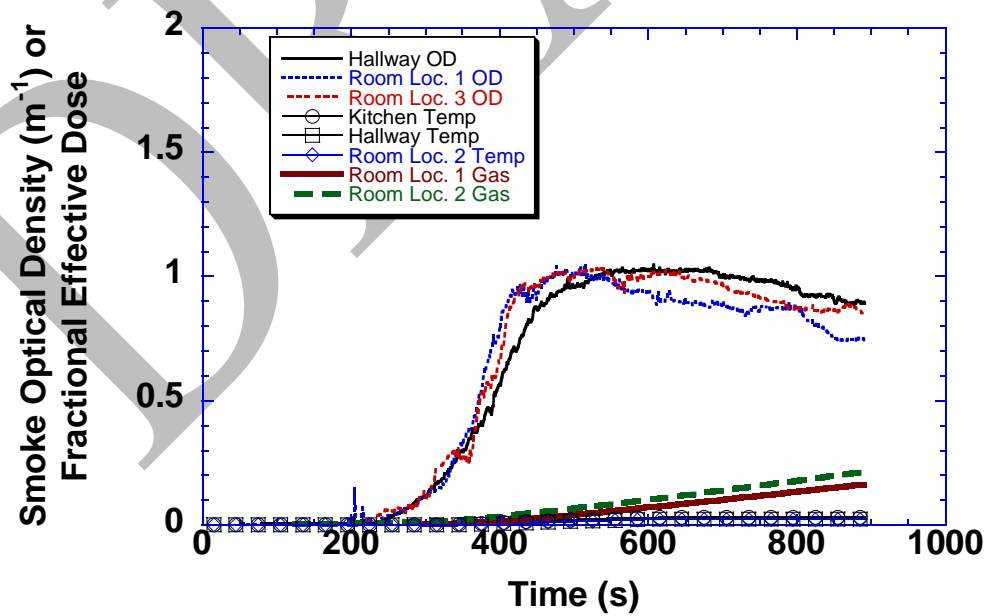


Figure 62. OD and FED values for experiment B2\_1 (Laminated pressboard, scenario 2).

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)								
1.87 (6.12)	147	161						
2.96 (9.72)			117					
3.33 (10.93)								149
4.50 (14.77)			139					145
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)		221						

Table 52. Alarm times for Experiment B2\_2 (Laminated pressboard, scenario 2).



Figure 63. Photo sequence for experiment B2\_2 (Laminated pressboard, scenario 2).





Figure 64. Post-fire photo of experiment B2\_2 (Laminated pressboard, scenario 2).

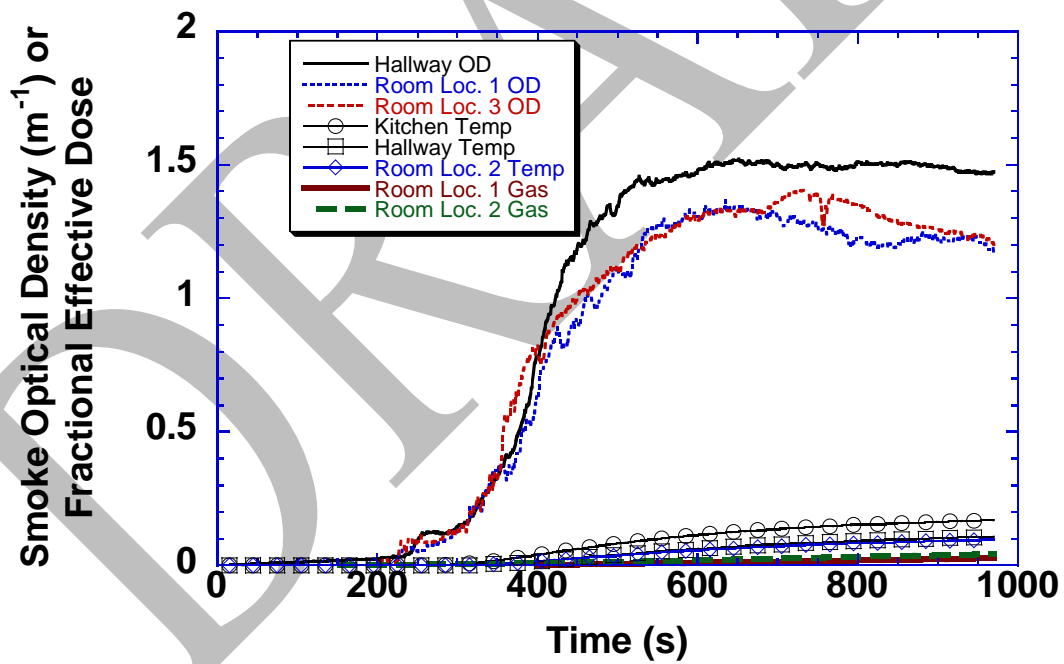


Figure 65. OD and FED values for experiment B2\_2 (Laminated pressboard, scenario 2).

Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)								
1.87 (6.12)	121	130						
2.96 (9.72)	127		125				133	
3.33 (10.93)								
4.50 (14.77)								
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)	219		203		213			

Table 53. Alarm times for Experiment A3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).



Figure 66. Photo sequence for experiment A3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).



Figure 67. Post-fire photo of experiment A3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).

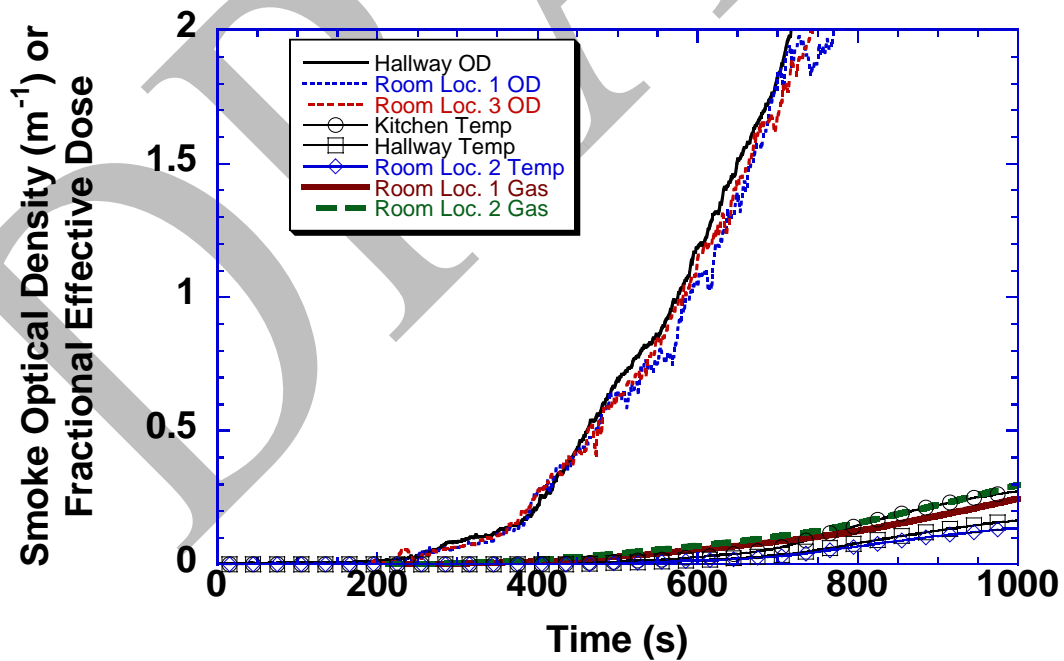


Figure 68. OD and FED values for experiment A3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).



Distance from Stove, m (ft)	P1 T <sub>a</sub> (s)	P2 T <sub>a</sub> (s)	I1 T <sub>a</sub> (s)	I2 T <sub>a</sub> (s)	D1 T <sub>a</sub> (s)	D2 T <sub>a</sub> (s)	M1 T <sub>a</sub> (s)	M2 T <sub>a</sub> (s)
1.82 (5.98)		125						
1.87 (6.12)								
2.96 (9.72)			133		151			
3.33 (10.93)								
4.50 (14.77)			142					141
5.39 (17.70)								
6.01 (19.71)								
6.94 (22.77)			197				217	

Table 54. Alarm times for Experiment B3\_1 (Laminated pressboard with sheet metal barrier, scenario 1).



Figure 69. Photo sequence for experiment B3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).



Figure 70. Pre-fire photo of experiment B3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).

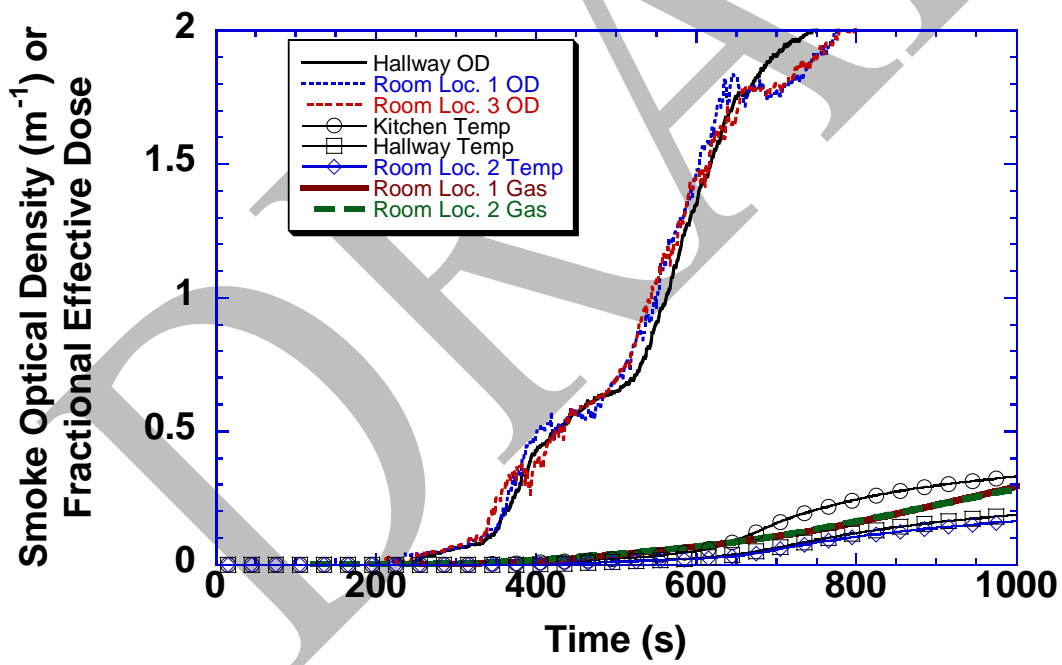


Figure 71. OD and FED values for experiment B3\_1 (Oak/pressboard with sheet metal barrier, scenario 1).

Every installed smoke alarm activated during the 10 experiments. Typically, a photoelectric alarm in the kitchen was the first to activate, and all smoke alarms activated within about 100 s of the first alarm activation. Since it appears that the early stage of fire growth is similar for the two ignition scenarios, similarity in alarm time range for all 10 experiments is not surprising.

At locations outside the kitchen where I1 was present, it alarmed first 16 out of 19 times. In one case M2 alarmed 1 s before I1 and in another, P1 alarmed at the same time as I1. Comparing the difference between the alarm times of P1, D1, M1, and M2 versus the alarm time of a collocated I1 alarm a relative sensitivity ranking is obtained. Figure 72 shows the average difference for the four alarms and I1. There were 5 to 10 observations for each alarm, and the error bars represent  $\pm$  one standard deviation. The range in alarm times for I1 was 115 s to 214 s. The average suggests an increasing sensitivity trend of P1-D1-M1-M2-I1 to these kitchen fires.

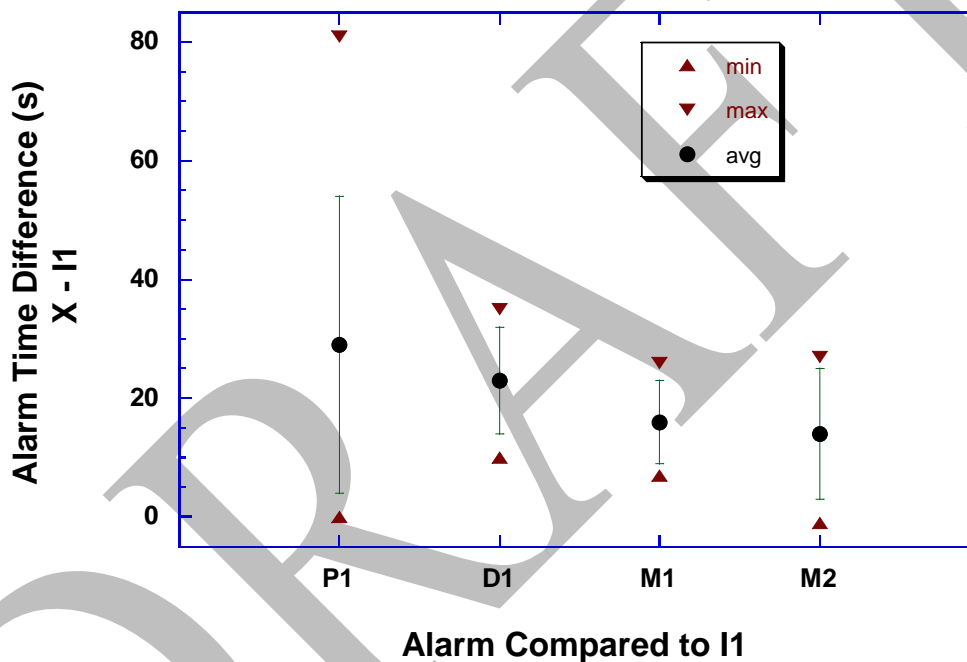


Figure 72. Average alarm time difference between Alarm type and collocated I1 alarm.

In order to compare the smoke alarm performance, an FED limiting value of 0.3 was chosen and two limiting smoke optical densities  $0.25 \text{ m}^{-1}$  and  $0.50 \text{ m}^{-1}$  were considered.

While there were cases when the FED for toxic gases or heat reached a limiting value of 0.3, smoke optical density always reached values greater than  $0.25 \text{ m}^{-1}$  well before any FED limit. The smoke optical density reached values greater than  $0.50 \text{ m}^{-1}$  well before any FED limit for all experiments except A2\_1 (Oak/pressboard, ignition scenario 2), which never reached an optical density limit of  $0.50 \text{ m}^{-1}$  nor a FED of 0.3. Table 55 shows the time to the first and last alarm activation for each experiment and the time to reach the smoke optical density limits of  $0.25 \text{ m}^{-1}$  or  $0.50 \text{ m}^{-1}$  for the three extinction meter locations. The last alarm activation time was always before the time to reach the  $0.25 \text{ m}^{-1}$  optical density limit; thus even with the slowest alarm activation, there was time to egress before significant smoke

obscuration. Thus, the available safe egress time (ASET) (defined as time to a FED or Smoke limit (whichever is reached first) minus the time to alarm) was positive. Any ASET for a particular smoke alarm activation time and time to reach a chosen smoke optical density limit can be computed using the tabulated values.

Test	First Alarm (s)	Last Alarm (s)	Time to Smoke OD Hallway		Time to Smoke OD Room Loc. 1		Time to Smoke OD Room Loc. 3	
			0.25 m <sup>-1</sup>	0.50 m <sup>-1</sup>	0.25 m <sup>-1</sup>	0.50 m <sup>-1</sup>	0.25 m <sup>-1</sup>	0.50m <sup>-1</sup>
A1_1	153	243	408	506	419	504	402	498
A1_2	117	248	423	486	455	502	433	480
A2_1	98	190	368	-	360	-	358	-
A2_2	119	205	348	390	349	396	340	375
B1_1	123	182	395	429	380	430	384	453
B1_2	113	193	351	399	342	390	353	391
B2_1	127	232	339	392	335	371	327	373
B2_2	117	221	330	380	332	376	324	357
A3_1	121	219	403	461	395	471	396	462
B3_1	125	217	371	424	369	400	350	424

Table 55. Tabulated first and last alarm activation time and time to reach threshold smoke optical densities.

Figure 73 shows available safe egress time (ASET) comparisons for four different cases, the difference between the time to reach an optical density limit of either 0.25 m<sup>-1</sup> or 0.50 m<sup>-1</sup> first in either the room or hallway locations and either the first or last alarm activation time. Thus, the shortest ASET was computed by using the last alarm activation time and the time to reach an optical density limit of 0.25 m<sup>-1</sup> and the longest ASET was computed by using the first alarm activation time and the time to reach the optical density limit of 0.50 m<sup>-1</sup>.

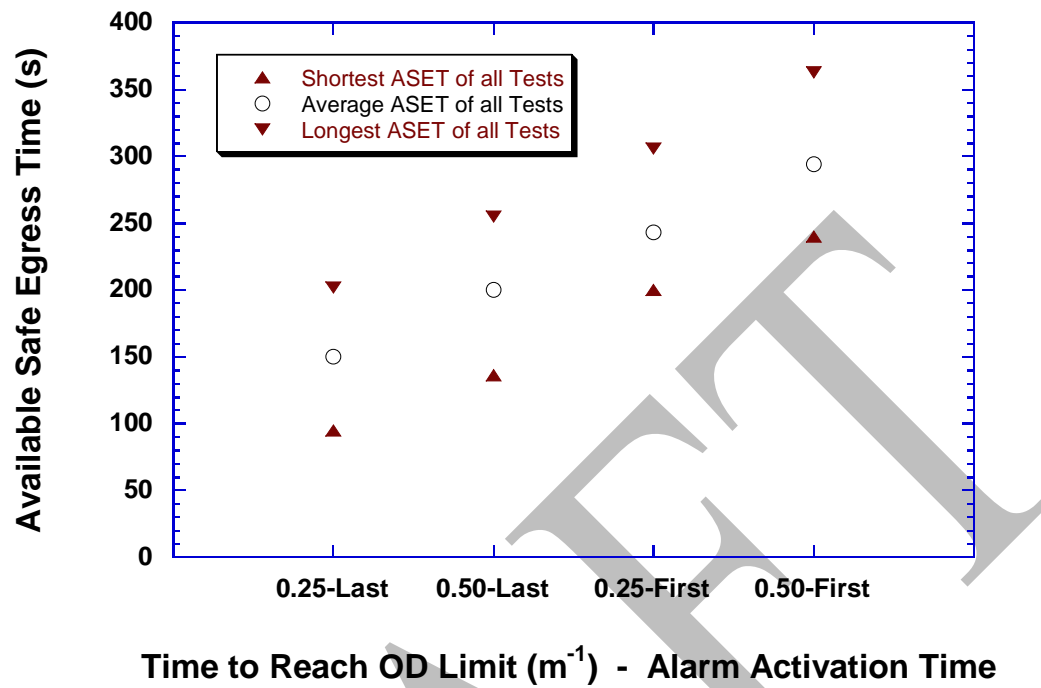


Figure 73. ASET computed using first or last alarm activation and time to reach 0.25 m<sup>-1</sup> or 0.50 m<sup>-1</sup> optical density limit.

The difference between the average ASET using alarm times from the first and last smoke alarms to activate is approximately 100 s for both optical density limits. Comparing the results for the shortest ASET computed for each experiment (that is, the last smoke alarm to activate and an optical density limit of 0.25 m<sup>-1</sup>), it varied from 95 s to 198 s, with an average value of 150 s for all 10 experiments. Only three computed ASET values were less than 120 s, two P1 alarms and one M1 alarm located at the furthest distance from the kitchen. While all of the smoke alarms provided ASET values greater than 94 s or 135 s, given an optical density limit of 0.25 m<sup>-1</sup> or 0.50 m<sup>-1</sup>, the results do reflect the need to place smoke alarms in central locations, to detect all fires in the protected space adequately.



## 4 Conclusions

The data collected provides insight into the fire growth and hazard development of kitchen fires, susceptibility of smoke alarms to cooking nuisance sources, and smoke alarm performance in kitchen fires. It is important to note that the overall performance of smoke alarms in residential settings is not limited to kitchen fire detection but includes a range of fire scenarios. There is a fairly extensive body of research documenting alarm performance on a wide variety of fire scenarios that must be considered to assess overall alarm performance. Specifically, the performance of M1 and M2 to a range of fire scenarios, including smoldering fires, has not been documented.

Several conclusions can be drawn from the experimental results. From the kitchen fire scenario heat release rate measurements, the following conclusions are drawn:

1. Combustible materials typically found on a counter top can spread flames to overhead cabinets.
2. A single cabinet can produce a peak heat release rate nearly sufficient to flashover a small room.
3. A protective barrier on the bottom and side facing the range may limit the spread of flames to the cabinet and tends to reduce the heat release rate.

From the kitchen nuisance alarm tests studied here, the following conclusions are drawn:

1. The propensity to nuisance alarm decreases as the distance from the cooking source increases.
2. Alarms (I1 and D2) that rely on sensitive ionization chambers experienced more nuisance alarm activations for cooking activities and locations tested in this study.
3. All alarms except I1 and D2 tend to experience the same nuisance alarm frequency for the locations outside the kitchen for the cooking scenarios tested.

From the kitchen fire tests studied here the following conclusions are drawn:

1. All smoke alarms tested responded before hazardous conditions developed; the I1 alarm tended to respond first at a given location.
2. Smoke alarms placed at the furthest location (6 m) may not provide adequate ASET times for the fire scenarios tested.
3. Alarms M1 and M2 appear to be more sensitive to the kitchen fire scenarios tested here than D1 and P1.

The location requirements specified in NFPA 72 would appear to reduce potential nuisance alarm problems, but it does not guarantee nuisance alarms would not be problematic in all situations. Specific tests for nuisance-resistant alarms could be tailored to remove the most egregious alarms and lead to high-performing nuisance-resistant alarms.

DRAFT

## 5 References

1. Karter, M.J., "Fire Loss in the United States 2008," National Fire Protection Association, Quincy, MA., September, 2009.
2. Ahrens, M., "Home Smoke Alarms – The Data as Context for Decision," *Fire Technology*, January 2008, DOI: 10.1007/s10694-008-0045-9.
3. Ahrens, M., "Smoke Alarms in US Home Fires," National Fire Protection Association, Quincy, MA., September, 2011.
4. Rowland D., et al. (2002) Prevalence of working smoke alarms in local authority inner city housing: randomized controlled trial. *BMJ*, 325, 998–1001.
5. Mueller, B.A., Sidman, E.A., Alter, H., Perkins, R., and Grossman, D.C., (2008) Randomized Controlled Trial of Ionization and Photoelectric Smoke Alarm Functionality, *Inj Prev* 2008;14:80–86. doi:10.1136/ip.2007.016725.
6. Yang, J., Jones, M.P., Cheng, G., Ramirez, M., Taylor, C., Peek-Asa, C., (2011) Do Nuisance Alarms Decrease Functionality of Smoke alarms Near the Kitchen? Findings from a Randomized Controlled Study, *Inj Prev* doi:10.1136/ip.2010.027805.
7. Ahrens, M., "Home Fires Involving Cooking Equipment," National Fire Protection Association, Quincy, MA., November, 2011.
8. Richard W. Bukowski, Richard D. Peacock, Jason D. Averill, Thomas G. Cleary, Nelson P. Bryner, William D. Walton, Paul A. Reneke, and Erica D. Kuligowski, NIST Technical Note 1455, *Performance of Home Smoke Alarms: Analysis of the Response of Several Available Technologies in Residential Fire Settings*, Washington, DC: U.S. Department of Commerce, National Institute of Standards and Technology, 2008 revision.
9. Mealy, C., Wolfe, A., and Gottuk, D., "Smoke Alarm Response and Tenability," AUBE 09, 14<sup>th</sup> International Conf. on Automatic Fire Detection, Duisburg Germany, Sept 8–10, 2009.
10. Lee, A., and Pineda D., "Smoke Alarms – Pilot Study of Nuisance Alarms Associated with Cooking," US Consumer Products Safety Commission, Bethesda, MD, March 2010.
11. NFPA 72, National Fire Alarm and Signaling Code, 2010 Edition, NFPA, Quincy MA.
12. UL 217 Single and Multiple Station Smoke Alarms, Underwriters Laboratories, Northbrook IL.
13. Bryant, R., Ohlemiller, T., Johnsson, E., Hamins, A., Grove, B., Guthrie, W.F., Maringhides, A. and Mulholland, G., The NIST 3 Megawatt Quantitative Heat Release Rate Facility, *NIST Special Publication 1007*, National Institute of Standards and Technology. Gaithersburg, MD, December 2003.
14. Cleary, T., "Characterization of Residential Nuisance Sources," NIST Technical Note in preparation.
15. ISO/FDIS 13751, "Life-threatening components of fire – Guidelines for the estimation of time available for escape using fire data," 2007

DRAFT